



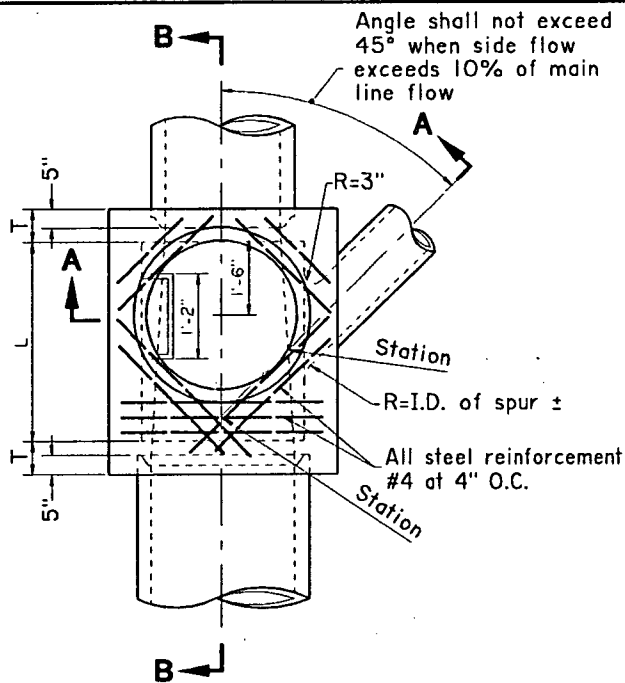


PLAN

Shaft Not Shown

Manhole frame, cover, and collar per Std. Dwg. 204
Street Surface

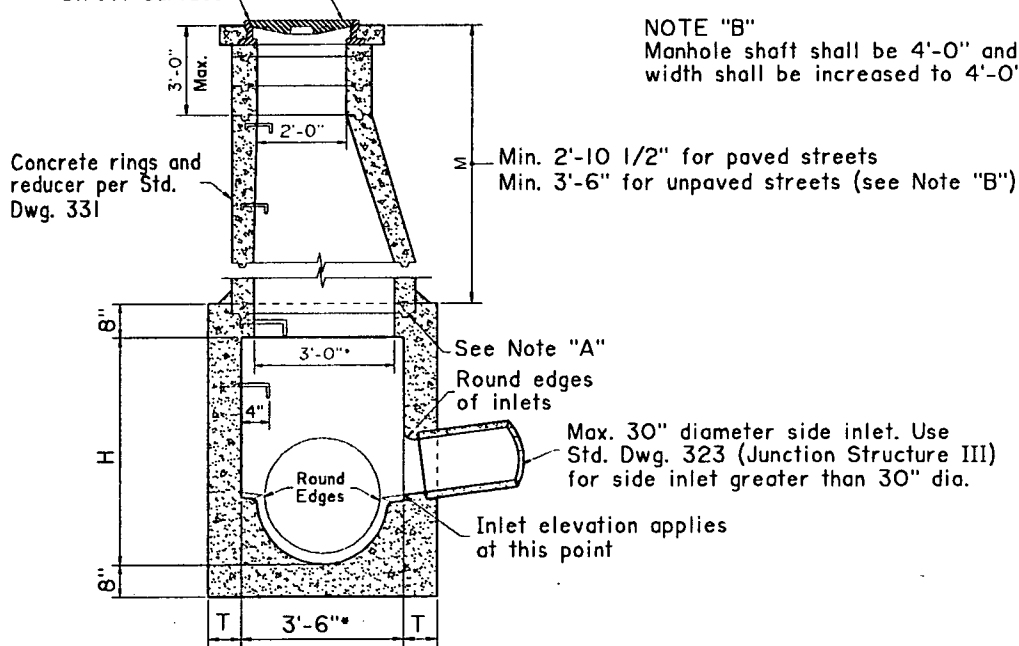

SECTION A-A

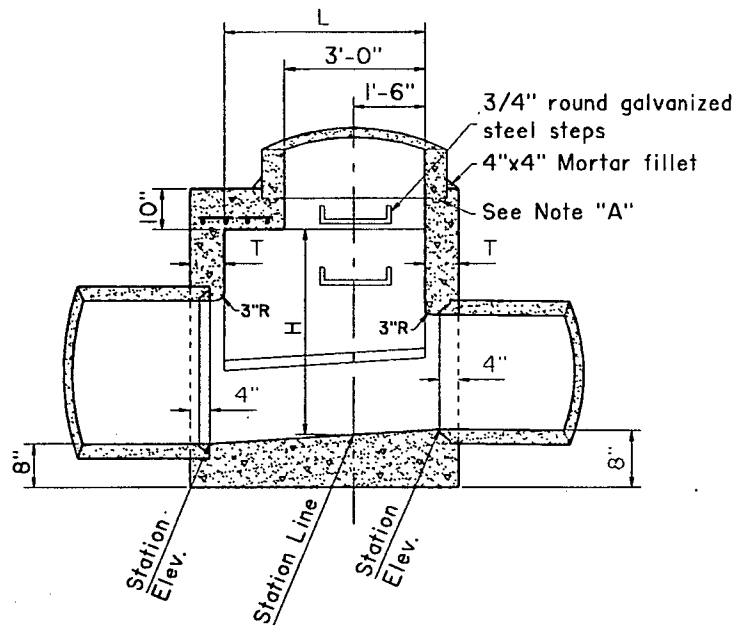

SECTION B-B

NOTE "A"

Two (2) inch deep seat to correspond to manhole shaft, grout between shaft and seal.

NOTE "B"

Manhole shaft shall be 4'-0" and Junction Structure bottom width shall be increased to 4'-0" minimum when M>15'.

Note: Use Junction Structure Type I for outlet pipe diameters of 42" or less, and side inlet diameters of 30" or less.

REVISED DATE _____ _____ _____ _____ _____	CITY OF FULLERTON ENGINEERING DEPARTMENT	DRAWN <u>PLS.</u> DATE <u>8/1/95</u>
	JUNCTION STRUCTURE TYPE I	STD. NO. 321 2 of 2
	APPROVED <u>Robert Anderson</u> DATE <u>8/16/95</u> DIRECTOR OF ENGINEERING	