



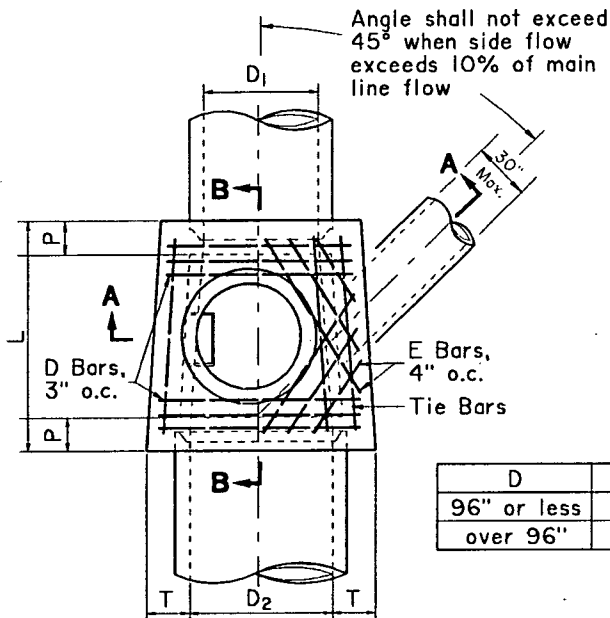

PLAN

Shaft not shown


Manhole frame, cover, and collar per Std. Dwg. 204
Street Grade

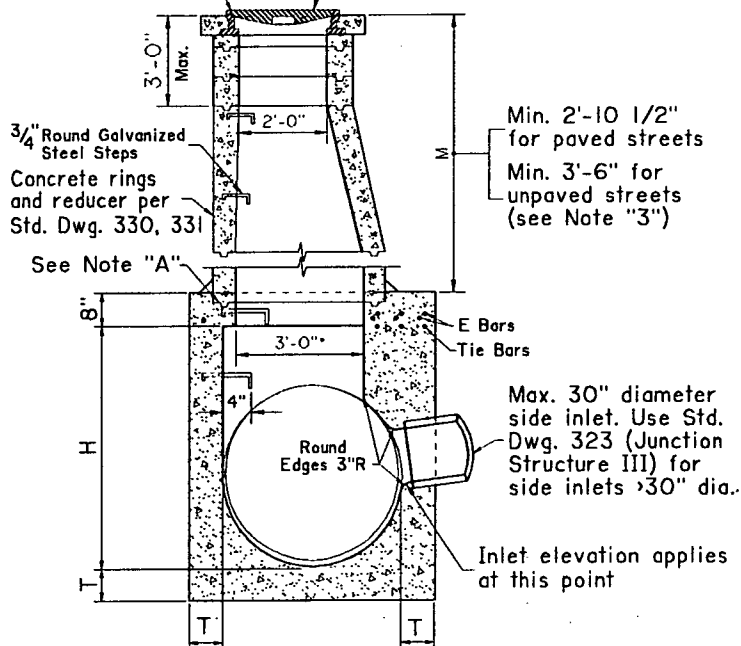

SECTION A-A


NOTE "A"

Two (2) inch deep seat to correspond to manhole shaft, grout between shaft and seal.

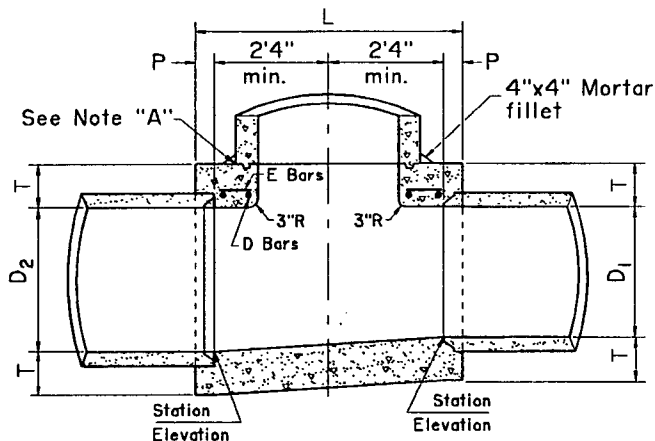


SECTION B-B

D	L (min)	P (min)
96" or less	5'-6"	5"
over 96"	6'-0"	8"

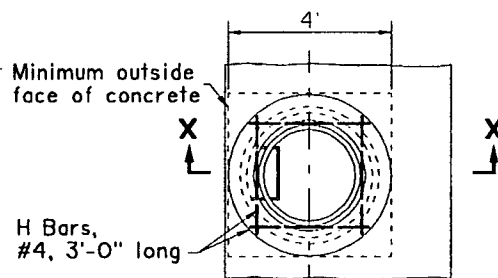

**DETAIL M
PLAN VIEW**

	Max.	Min.
For Paved Streets	11"	8 1/2"
For Unpaved Streets	16"	15"

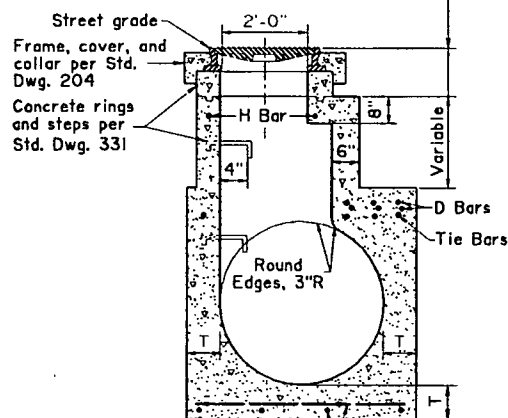

Reinforce floor for pipes greater than 60" dia., #4 at 12" o.c. both ways

**DETAIL M
SECTION X-X**

Note: Use Junction Structure Type II for D pipe diameters of 42" or greater and side inlet pipe diameters of 30" or less.

DRAWN PLS.

DATE 8/1/95

**CITY OF FULLERTON
ENGINEERING DEPARTMENT**

REVISED

DATE

STD. NO.

322

1 of 2

JUNCTION STRUCTURE TYPE II

APPROVED

Robert Anderson
DIRECTOR OF ENGINEERING

DATE

8/16/95