


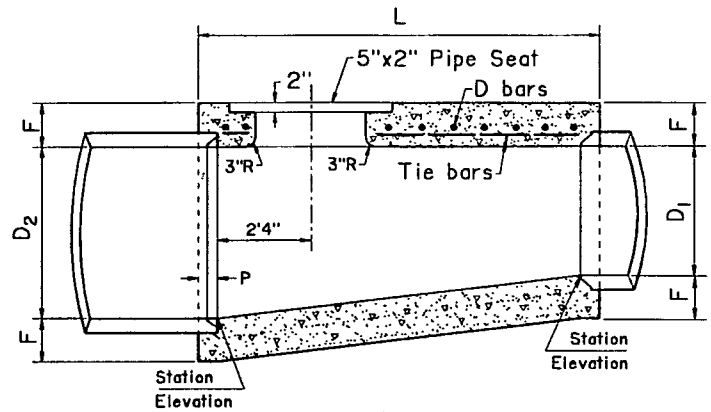


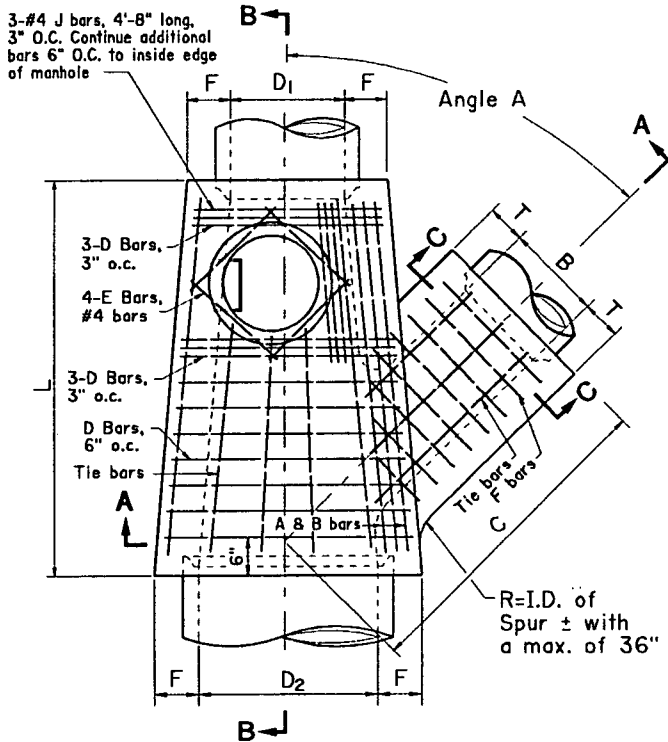

SECTION B-B



SECTION C-C

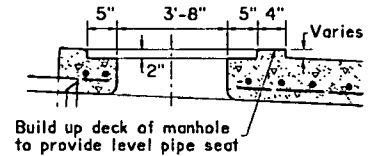


SEAT FOR SHAFT WHEN
TOP IS NOT LEVEL


TABLE OF BAR SIZES		
D ₂ OR B	A & B Bars	D or F bars
33"-39"	#5 @ 3"	#4 @ 6"
42"-84"	#6 @ 3"	#5 @ 6"
90"-96"	#7 @ 3"	#6 @ 6"

Manhole frame, cover, and
collar per Std. Dwg. 204

Street Grade

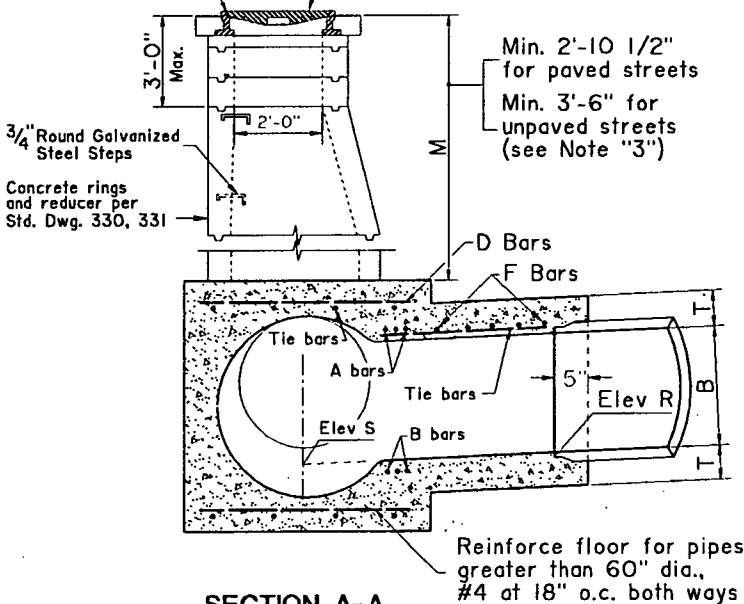

SECTION A-A

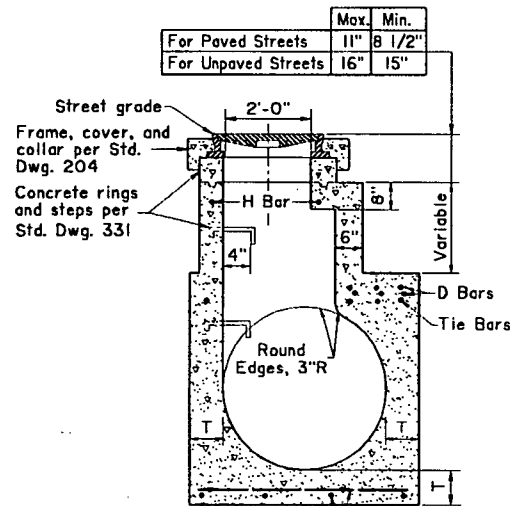

Reinforce floor for pipes
greater than 60" dia.,
#4 at 18" o.c. both ways

DETAIL M

Note: Use Junction Structure Type III for D₂ pipe diameters of 36" or greater, and inlet (B) diameters of 33" or greater.

DRAWN P.L.S.

DATE 8/1/95

CITY OF FULLERTON
ENGINEERING DEPARTMENT

REVISED

DATE

STD. NO.

323

1 of 2

JUNCTION STRUCTURE TYPE III

APPROVED

Robert Hudson
DIRECTOR OF ENGINEERING

DATE

8/16/95