



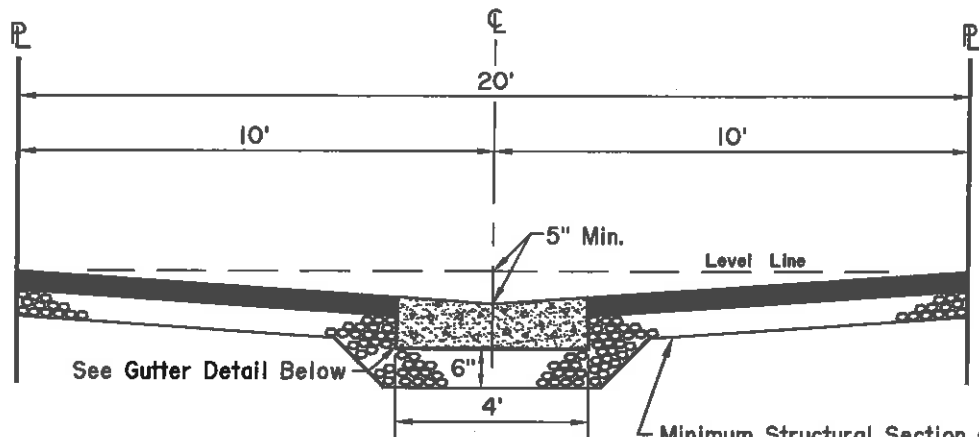

Minimum Structural Section shall be 4" asphalt concrete over 6" Class 2 A.B. 6" Class 2 A.B. base required under gutter. Compacted to 95% relative compaction.

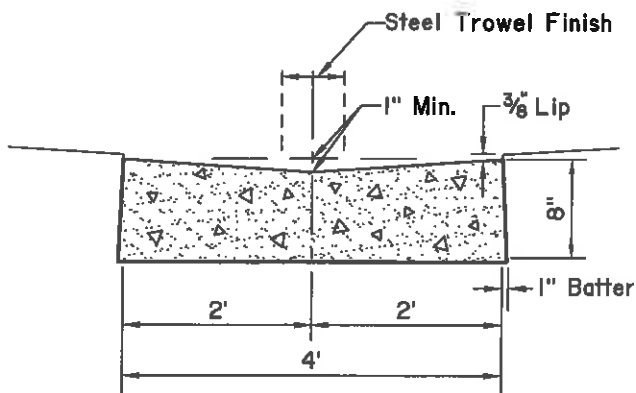

**STANDARD ALLEY GUTTER
CONCRETE**

NOTES

1. Weakened plane joints (2" deep) are required at 20' minimum to 40' maximum intervals.
2. 6" Class 2 A.B. required under gutter. A.B. compacted to 95% relative compaction.
3. No expansion joints and/or construction joints permitted, except when authorized by the Director of Engineering.
4. 4" to 6" wide steel trowel finish at center of gutter.
5. Concrete to be Class 560-C-3250, 4" max. slump.

DRAWN PLS

DATE 8/1/95

STD. NO.

104

**CITY OF FULLERTON
PUBLIC WORKS DEPARTMENT**

TYPICAL ALLEY SECTION

APPROVED

[Signature]
DIRECTOR OF PUBLIC WORKS

DATE 10-1-2013

REVISED

DATE 1/10/02

7/29/03

4/30/06

9/24/13