
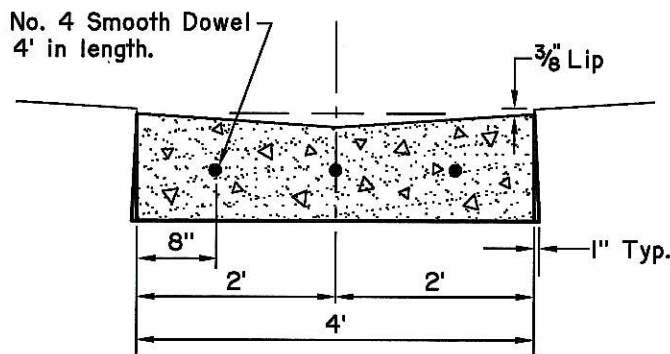


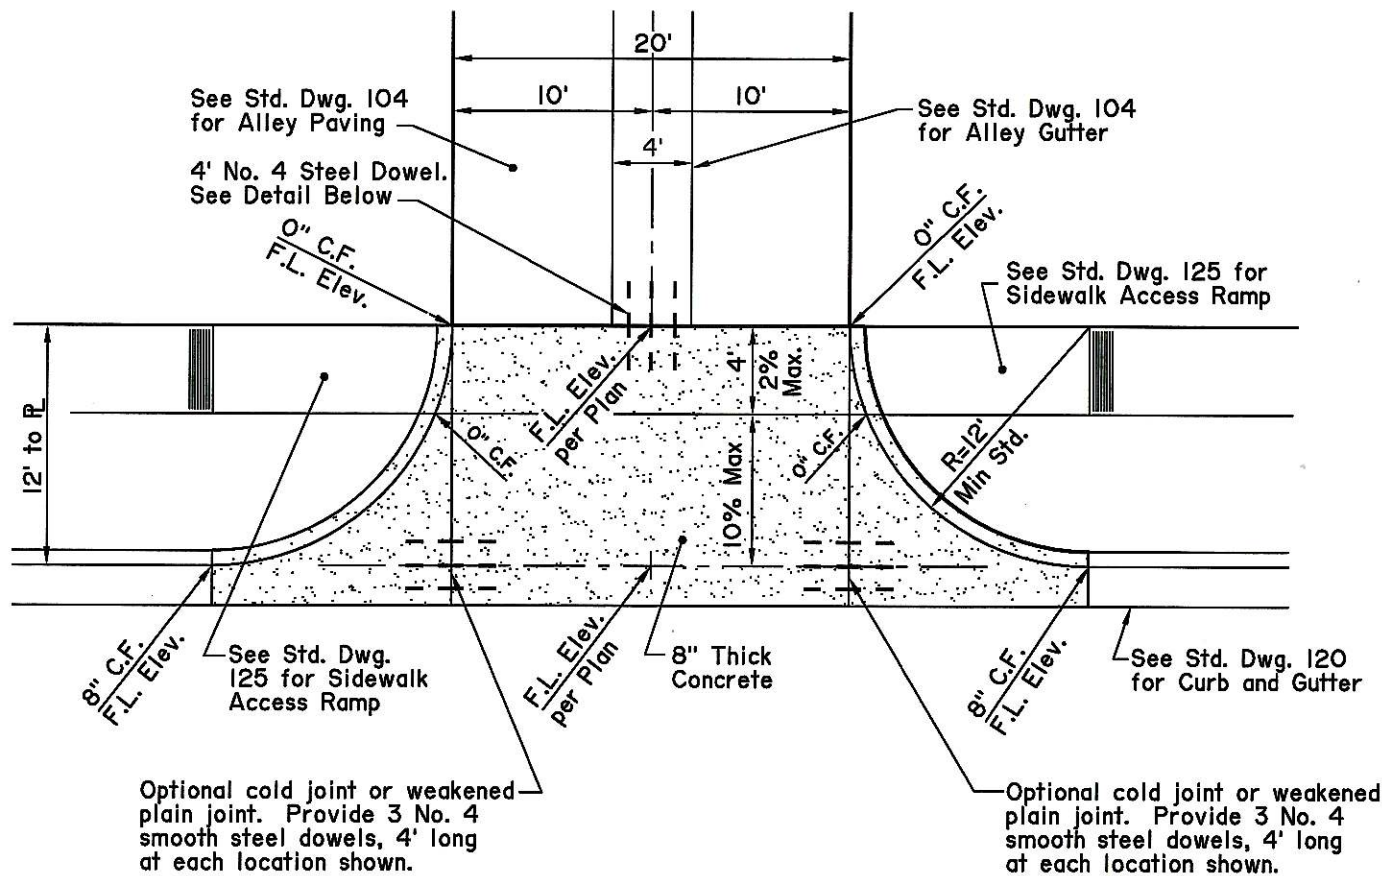

DOWEL LOCATION DETAIL

NOTES

1. 6" Class 2 A.B. required in all areas unless waived by the Director of Engineering. Compact A.B. to 95% relative compaction.
2. Curb radius variable with approval from the Director of Engineering.
3. Sidewalk access ramps required per Std. Dwg. 125.
4. Aprons end at R.L. unless modified by the Director of Engineering.
5. Concrete to be CLASS 560-C-3250, 4" max. slump.
6. Curb returns to be poured monolithically with apron/spandrel.

REVISED DATE <u>5/8/97</u> <u>1/10/02</u> <u>4/30/09</u>	CITY OF FULLERTON ENGINEERING DEPARTMENT STANDARD ALLEY RETURN APPROVED <u>DK [Signature]</u> DATE <u>6-2-09</u> DIRECTOR OF ENGINEERING	DRAWN <u>PLS</u> DATE <u>8/1/95</u> STD. NO. 107
---	--	--