




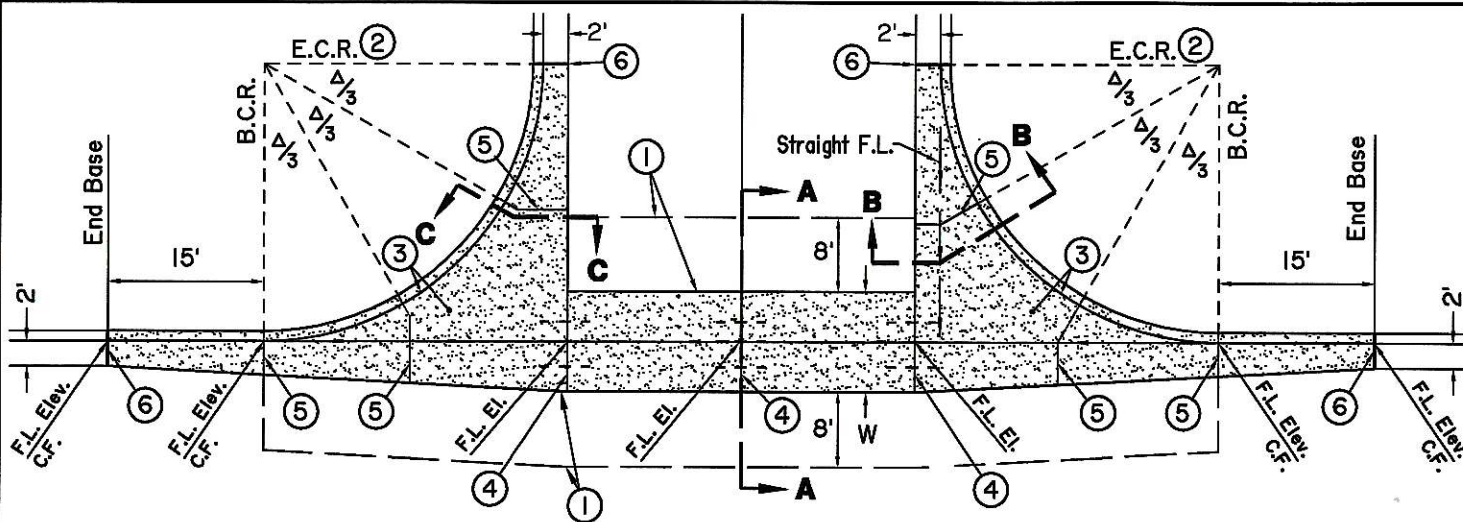


PLAN

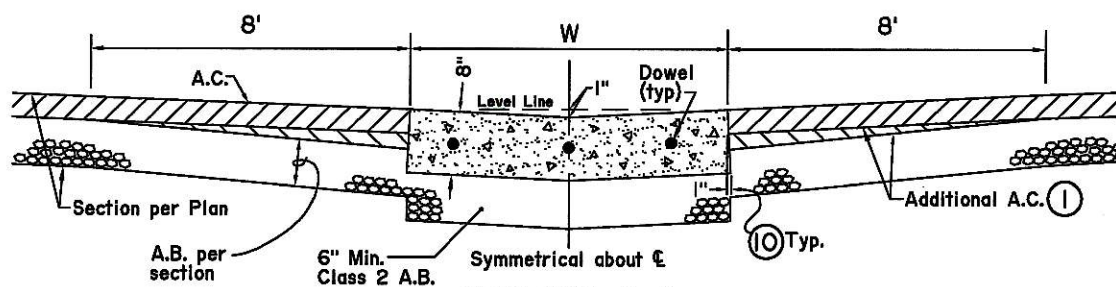

SECTION A-A

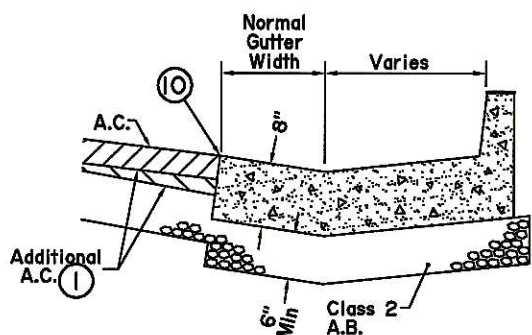

SECTION B-B

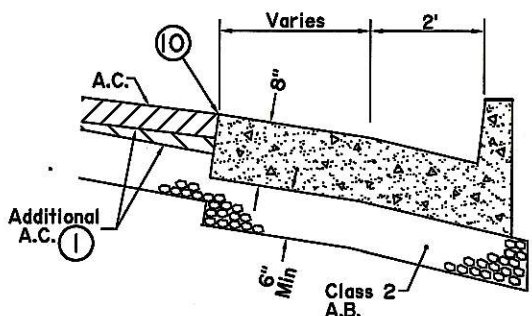

SECTION C-C

NOTES

- ① Thickened pavement consists of specified street section + 2" A.C. at concrete tapering (8' wide).
- ② Curb return radius shall be per Std. Dwg. 123, or per Plan.
- ③ Curb returns, spandrels, and gutter shall be poured monolithic.
- ④ Optional cold joint or weakened plain joint. Provide 3 No. 4 smooth steel dowels, 4' long at each location shown.
- ⑤ 1/4" deep score line.
- ⑥ Standard 1/4" expansion joint material.
- ⑦ Minimum 6" Class 2 A.B. required under all concrete. Compact A.B. to 95% relative compaction.
- ⑧ Normal spandrel width (W) is 8'. Optional W=6' may be used only with special approval by the Director of Engineering.
- ⑨ Concrete to be Class 560-C-3250, 4" max. slump.
- ⑩ All concrete abutting A.C. shall be constructed with a 1" batter.

DRAWN P.L.S.

DATE 8/1/95

STD. NO.

108

**CITY OF FULLERTON
ENGINEERING DEPARTMENT**

**STANDARD 6' or 8' CROSS-GUTTER
AND RETURN SPANDREL**

APPROVED

DIRECTOR OF ENGINEERING

DATE 6-2-09

REVISED

DATE 5/5/97

4/30/09