




PLAN

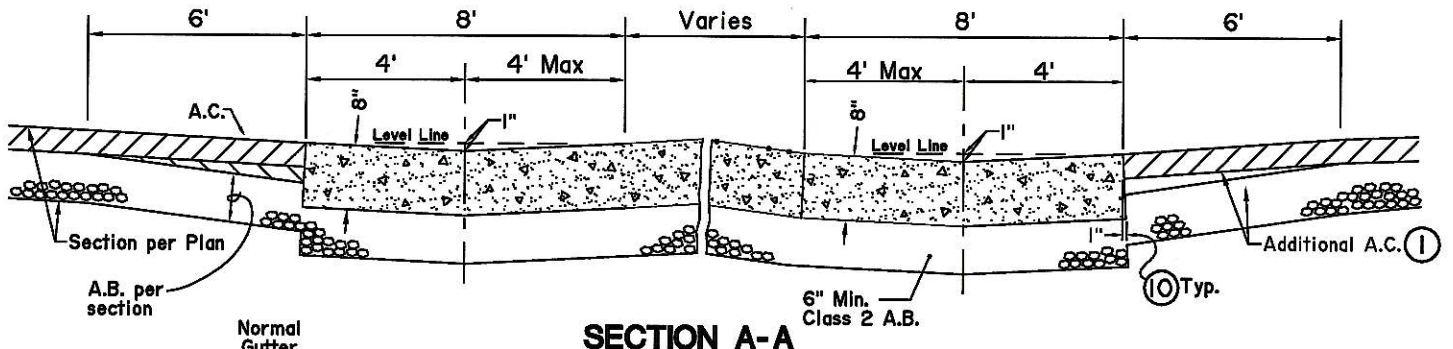

SECTION A-A

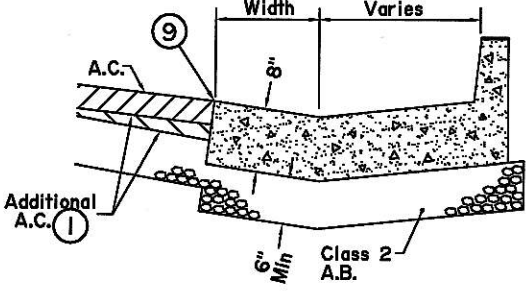

SECTION B-B

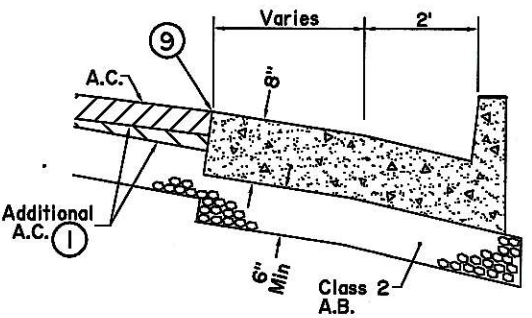

SECTION C-C

NOTES

- ① Thickened pavement consists of specified street section + 2" A.C. at concrete tapering (8' wide).
- ② Curb return radius shall be per Std. Dwg. 123, or per Plan.
- ③ Curb returns, spandrels, and gutter shall be poured monolithic.
- ④ Optional cold joint or weakened plain joint. Provide 3 No. 4 smooth steel dowels, 4' long at each location shown.
- ⑤ 1/4" deep score line.
- ⑥ Standard 1/4" expansion joint material.
- ⑦ Minimum 6" Class 2 A.B. required under all concrete. Compact A.B. to 95% relative compaction.
- ⑧ Concrete to be Class 560-C-3250, 4" max. slump.
- ⑨ All concrete abutting A.C. shall be constructed with a 1" batter.

REVISED
DATE <u>5/6/97</u>
<u>4/30/09</u>

CITY OF FULLERTON
ENGINEERING DEPARTMENT

SPECIAL CROSS GUTTER
STEEP GRADES

APPROVED *DK* DATE 6-2-09
DIRECTOR OF ENGINEERING

DRAWN <u>PLS</u>
DATE <u>8/1/95</u>
STD. NO.
109
1 of 2