



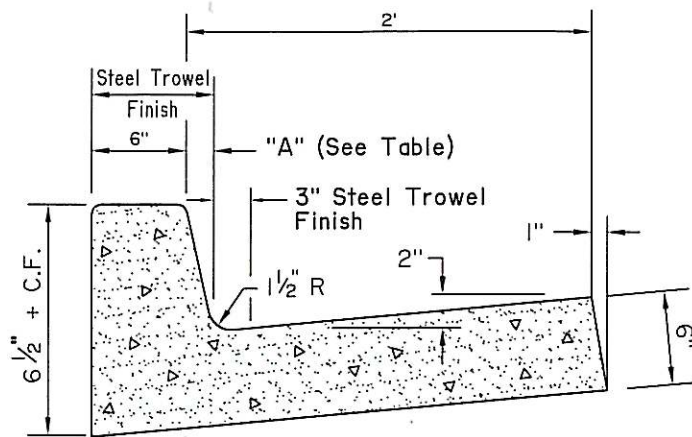


**TYPE A**

| CURB FACE | "A"    |
|-----------|--------|
| 4"        | 3/4"   |
| 6"        | 1 1/8" |
| 8"        | 1 1/2" |
| 10"       | 1 7/8" |

Note: Curb face heights other than 8" require prior approval by the Director of Engineering.

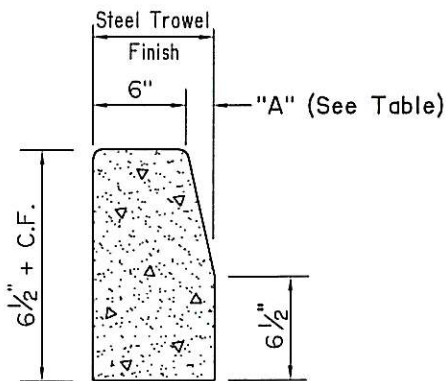


**TYPE B-1**

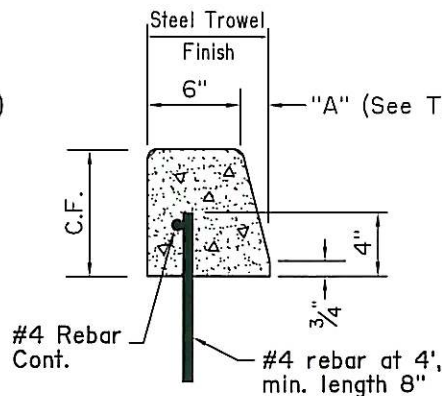

**TYPE B-2**

(Prior Approval Required)

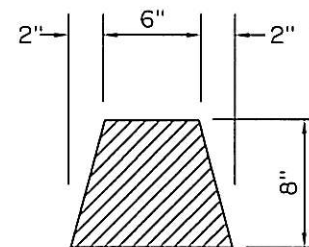

**TYPE C**

(A.C. Berm)

### NOTES

1. All exposed edges shall have a 1/2" radius except the gutter flow line shall be 1 1/2" radius.
2. Gutter shall have a fine-broom finish except where steel trowel finish is indicated.
3. Slope gutter in plane of pavement if cross slope of pavement is away from curb (when directed).
4. Extruded curb requires prior approval by the City Engineer.
5. Weakened plane joints shall be placed in curbing at regular intervals, not less than 10' or greater than 20' apart. Joints shall be 2" minimum depth in curbing. Expansion paper at 60' intervals, plus all B.C., E.C., top of "X", etc.
6. A crushed aggregate base, 6" thick, shall be placed under all curb or curb and gutter. Minimum compaction of 90% on subgrade and 95% on aggregate base is required.
7. For removal and replacement of concrete items abutting A.C. pavement, a minimum width of 12" of A.C. shall be sawcut and removed adjacent to the construction. The A.C. pavement shall be replaced within 48 hours of the concrete pour, unless a longer time is approved by the Engineer prior to any removal.
8. On Private Streets, back of curb shall be located a minimum of 2" clear from the Property Line.
9. Concrete to be Class 520-C-2500, 4" max. slump.

|                         |                                             |                    |
|-------------------------|---------------------------------------------|--------------------|
| DRAWN <u>PLB</u>        | CITY OF FULLERTON<br>ENGINEERING DEPARTMENT | REVISED            |
| DATE <u>8/1/95</u>      |                                             | DATE <u>5/7/97</u> |
| STD. NO.                | STANDARD CURBS AND GUTTER                   | <u>4/28/09</u>     |
| 120                     |                                             |                    |
| APPROVED <u>DK</u>      | DATE <u>5-12-09</u>                         |                    |
| DIRECTOR OF ENGINEERING |                                             |                    |