




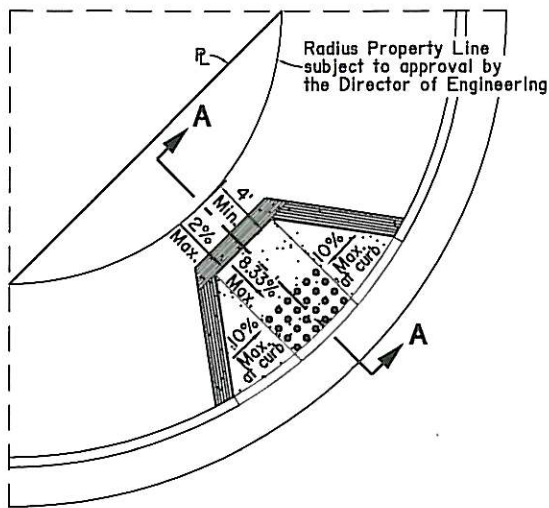

TYPE A

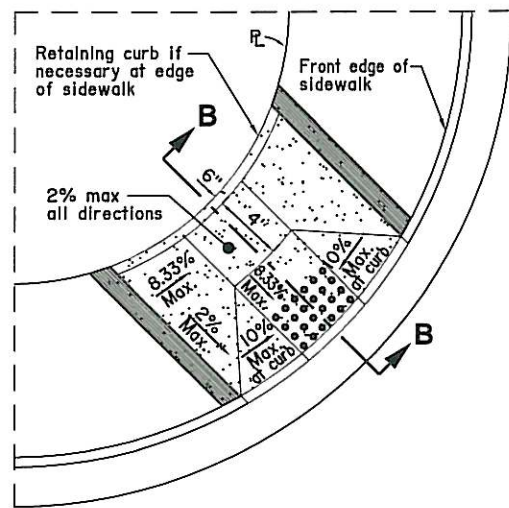


TYPE B

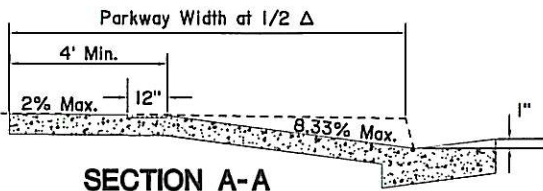

SECTION A-A

OPTION: If R/W is available, omit curb and grade as required.

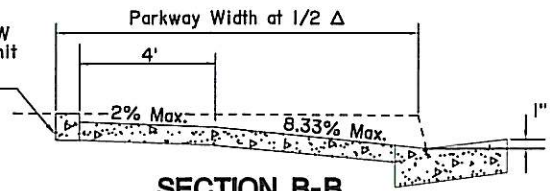

SECTION B-B

NOTES

1. Sidewalk and ramp thickness shall be 4" concrete. Concrete shall be Class 520-C-2500, 4" max. slump.
2. Ramp shall be located at 1/2 Δ unless otherwise specified.
3. See Standard Drawing No. 122 for additional construction notes.
4. For sidewalk access ramp details refer to State of California Department of Transportation Standard Plans A88A and A88B.

DRAWN PLS
DATE 8/1/95

STD. NO.
124

**CITY OF FULLERTON
ENGINEERING DEPARTMENT**

SIDEWALK ACCESS RAMP

APPROVED

DKH
DIRECTOR OF ENGINEERING

DATE 5-12-09

REVISED

DATE 5/7/97

3/26/02

2/10/05

4/28/09