



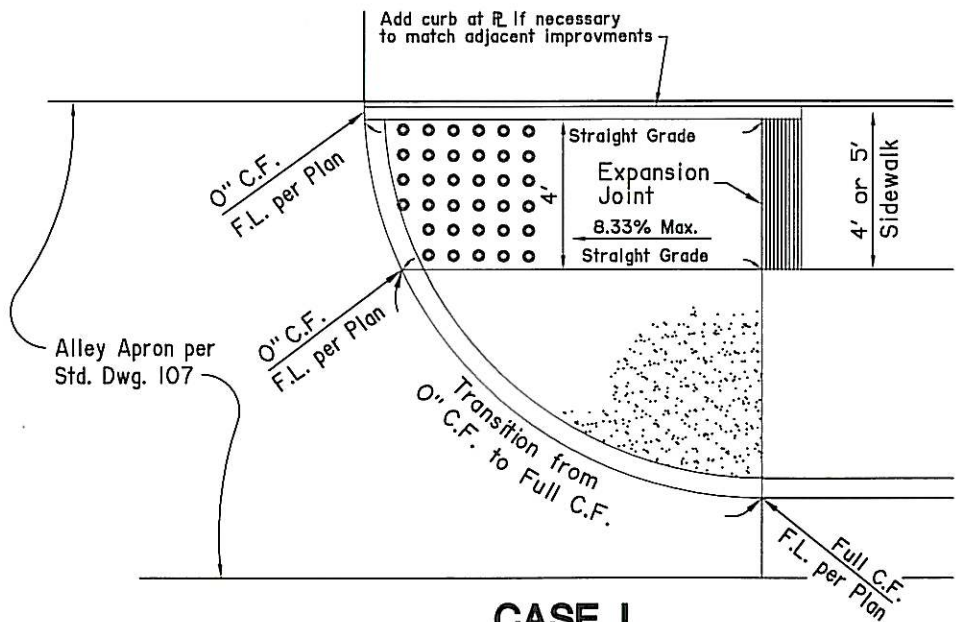

CASE I

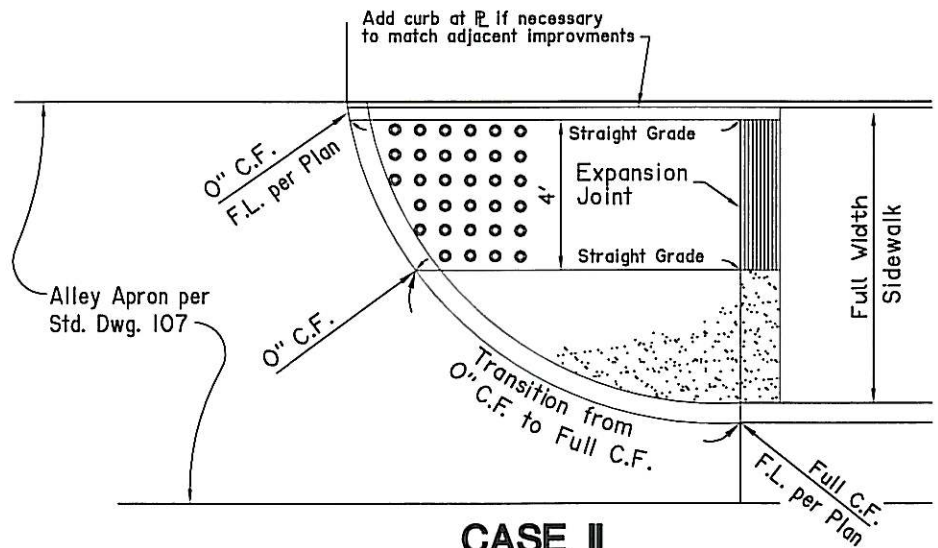

CASE II

NOTES

1. Grade on ramp shall not exceed 8.33%. Maximum crossfall allowed on sidewalk is 2%.
2. Ramp to be 4" thick concrete, Concrete shall be Class 520-C-2500, 4" max. slump.
3. All existing concrete to be removed shall be sawcut as directed.
4. Damaged or removed sidewalk to be replaced with 4" thick concrete per Std. Dwg. No. 122.
5. Horizontal curb cutting is allowed with prior approval.
6. Ramps to be located other than shown must have special approval.
7. A sand bedding (S.E. ≥ 25), 4" thick, shall be placed under all sidewalks where ground is soft, spongy, or expansive. Minimum compaction of 90% is required.
8. For sidewalk access ramp details refer to State of California Department of Transportation Standard Plans A88A and A88B.

REVISED DATE <u>5/7/87</u> <u>2/10/05</u> <u>4/28/09</u>	CITY OF FULLERTON ENGINEERING DEPARTMENT ALLEY TYPE SIDEWALK ACCESS RAMP APPROVED <u>[Signature]</u> DATE <u>5-12-09</u> DIRECTOR OF ENGINEERING	DRAWN <u>PLS.</u> DATE <u>8/1/85</u> STD. NO. 125
---	--	--