



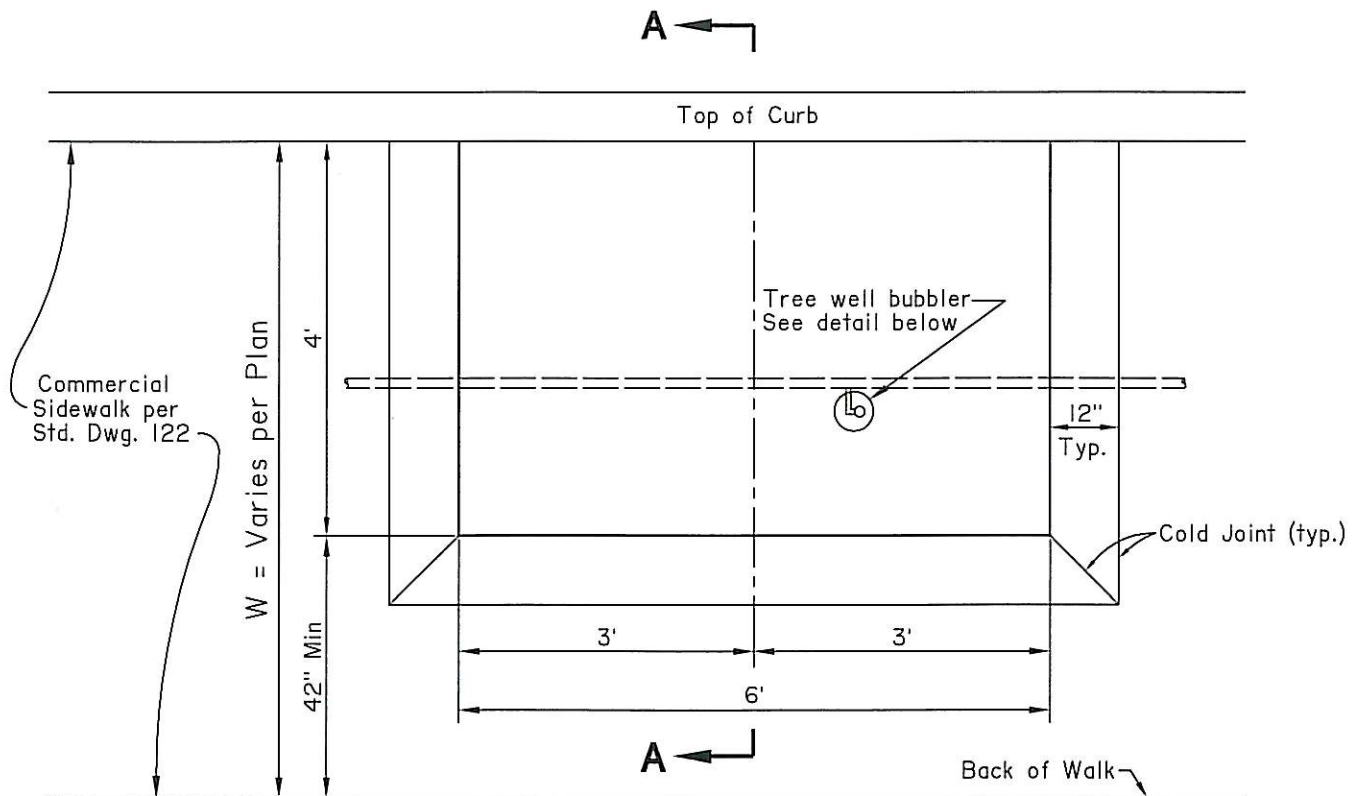

CONSTRUCTION NOTES


1. Excavate tree well 4" below sidewalk grade and remove all excess soil and debris from site.
2. Wherever practicle, irrigation shall be provided by adjoining property owner.

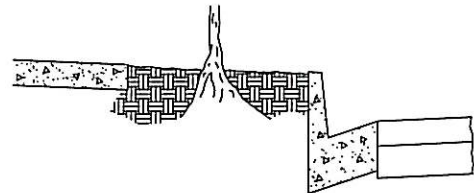

SECTION A-A

LOCATION NOTES

1. Tree wells shall be located a minimum of:
 - a. 15' from light standards and commercial driveways.
 - b. 5' from fire hydrants, utility meters, and sewer lateral locations.
 - c. 40' from B.C.R.'s
 - d. 10' from residential driveways
2. Final location of tree wells to be approved by the Director of Engineering.

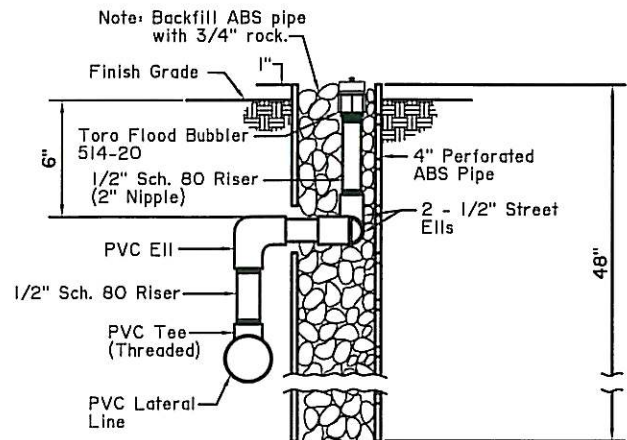

TREE WELL IRRIGATION

DRAWN <u>U.C.</u> DATE <u>3/8/2001</u>	CITY OF FULLERTON ENGINEERING DEPARTMENT	REVISED DATE <u>8/30/97</u>
	STANDARD TREE WELL	DATE <u>1/10/02</u> DATE <u>4/28/09</u>
STD. NO. 126	APPROVED <u>DK Long</u> DIRECTOR OF ENGINEERING	DATE <u>5-12-09</u>