



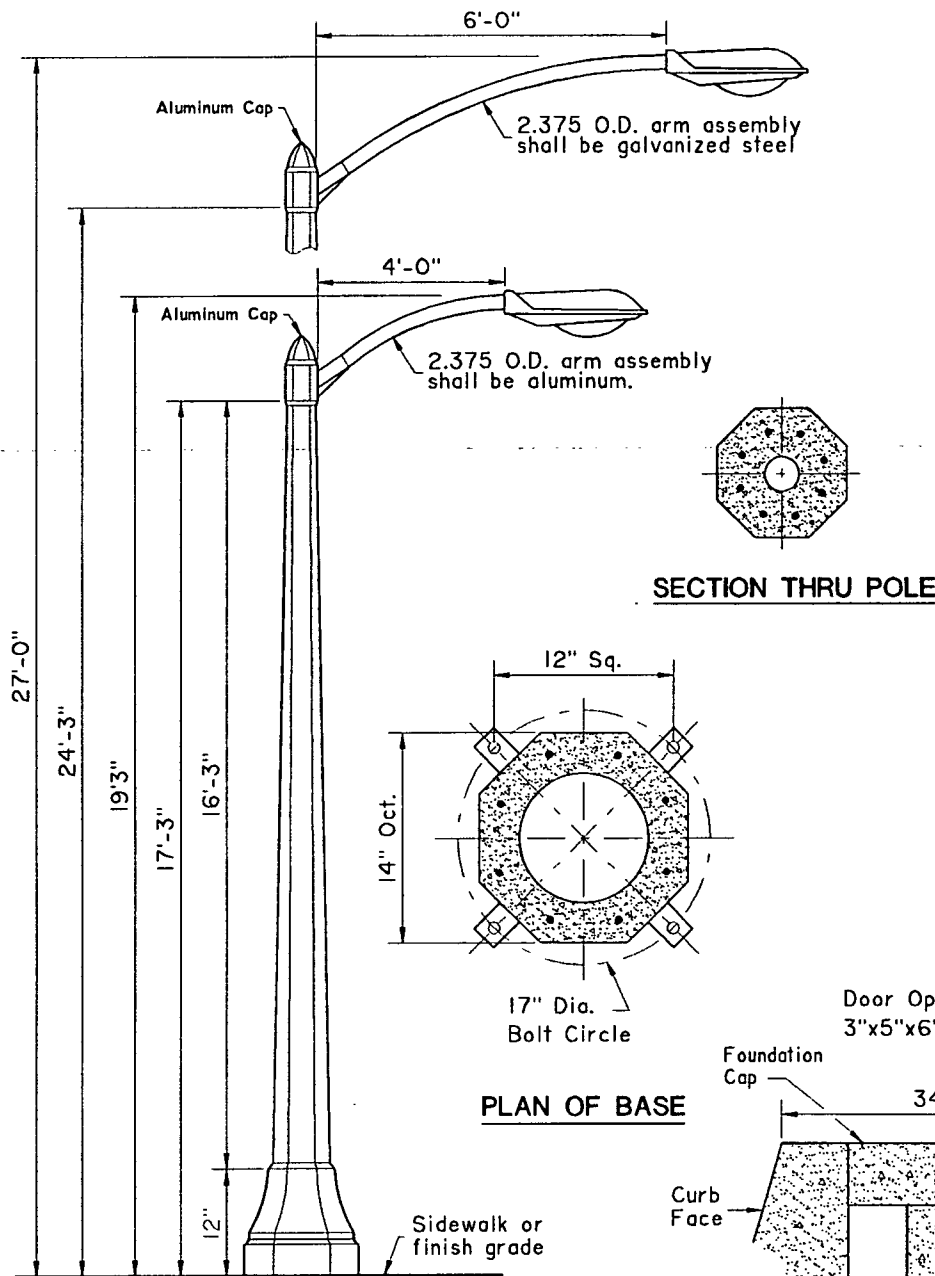

NOTES

- Standard shall be equipped with High Pressure Sodium Vapor Luminaire with internal ballast and lamp of the wattage specified on the plans.
- Luminaire shall be the type specified in the City of Fullerton Standard Specifications for Ornamental Street Lighting System.
- Where standard placement reduces sidewalk width to less than 48", pole shall be located as directed by the Director of Engineering.

4 Anchor rods:
1" x 18" x 3" (41-D4)
1" x 36" x 4" (45-D6)

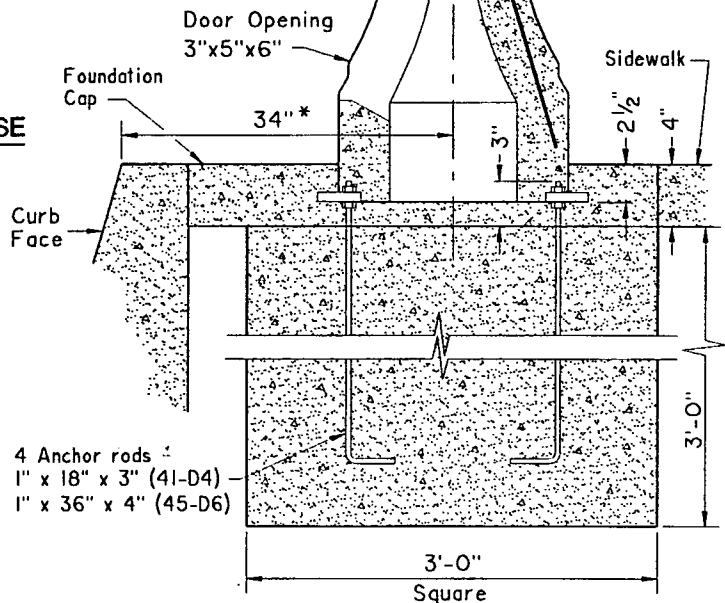

* Locate back of foundation at back of full width 6' sidewalk to provide handicap access.

REVISED

DATE

CITY OF FULLERTON
ENGINEERING DEPARTMENT

PRESTRESSED CONCRETE ELECTROLIER
19' 3" AND 27' 0" MOUNTING HEIGHTS

APPROVED

DIRECTOR OF ENGINEERING

DATE

8/16/95

DRAWN P.L.S.

DATE 8/1/95

STD. NO.

502