

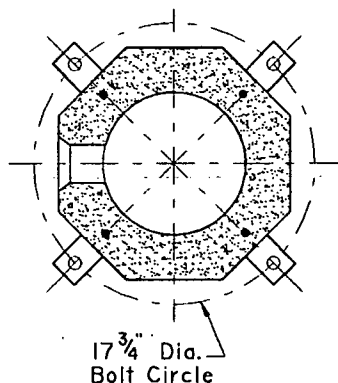


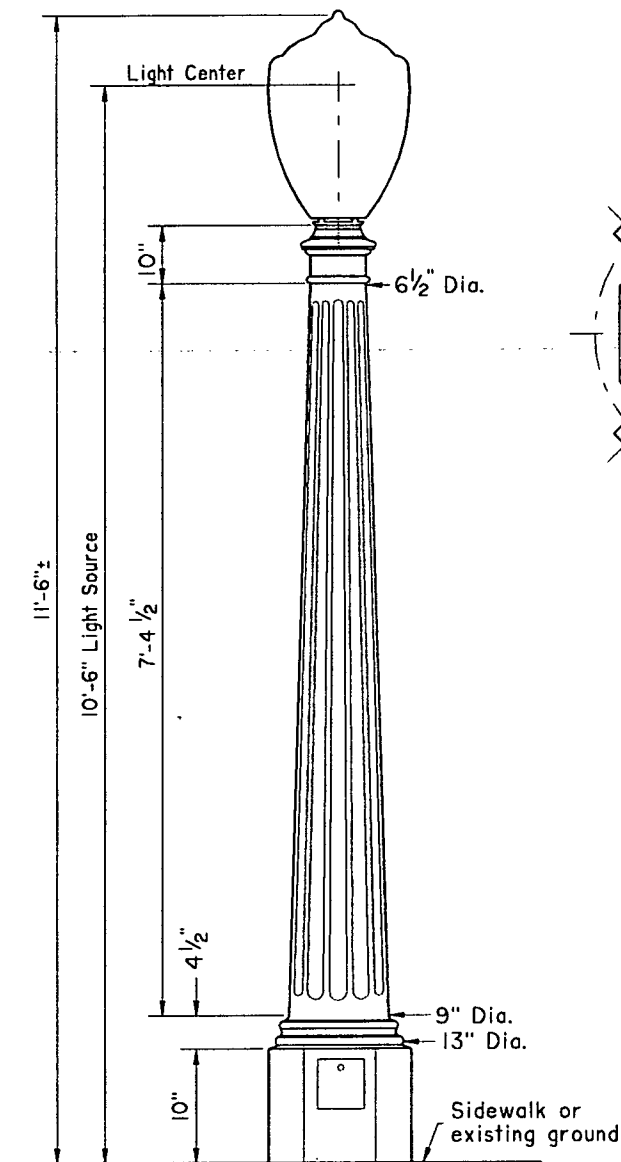

PLAN OF BASE

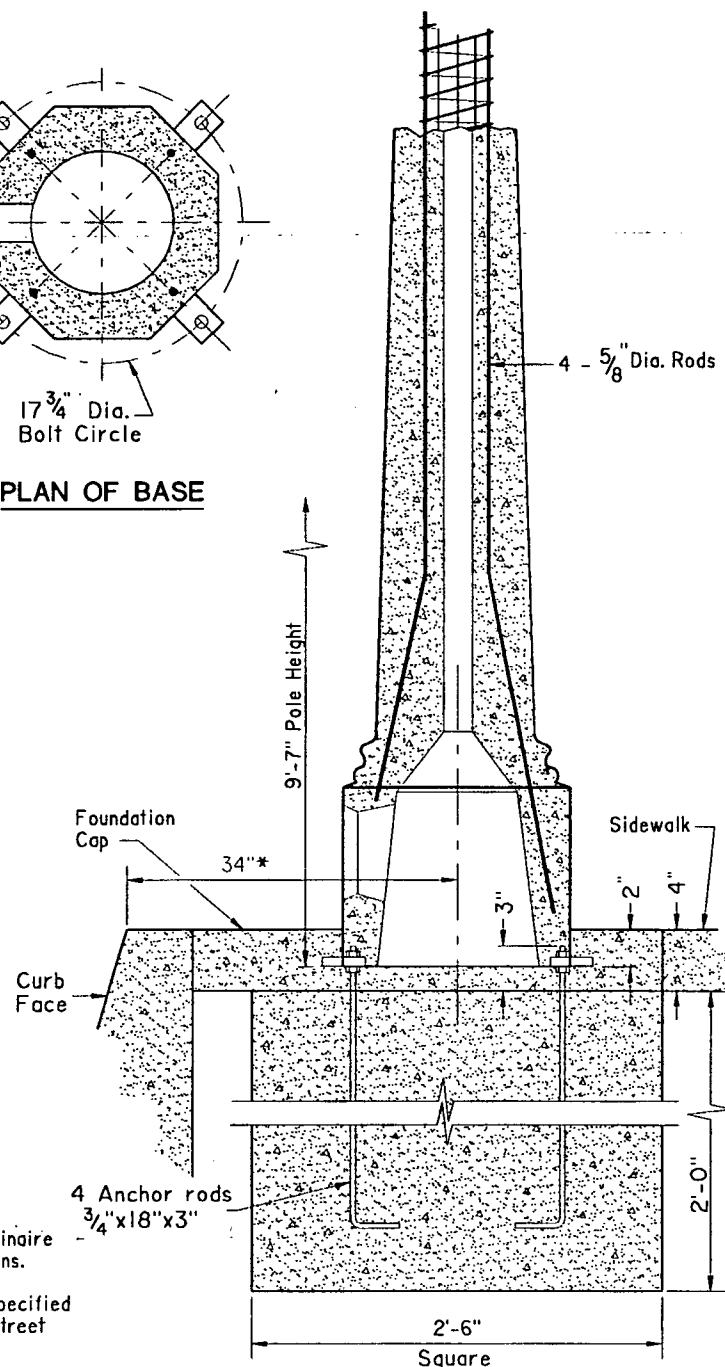

NOTES

1. Standard shall be equipped with High Pressure Sodium Vapor Luminaire with internal ballast and lamp of the wattage specified on the plans.
2. Globe assembly, globe adapter, and ballast shall be of the type specified in the City of Fullerton Standard Specifications for Ornamental Street Lighting Systems.
3. Where standard placement reduces sidewalk width to less than 48", pole shall be located as directed by the Director of Engineering.

* Locate back of foundation at back of full width 6' sidewalk to provide handicap access.

DRAWN P.L.S.

DATE 8/1/95

STD. NO.

503

**CITY OF FULLERTON
ENGINEERING DEPARTMENT**

**CENTRIFUGALLY SPUN REINFORCED
CONCRETE ELECTROLIER**

APPROVED

DIRECTOR OF ENGINEERING

DATE

8/16/95

REVISED

DATE