

6" OR 8" C.M.U. GARDEN WALL

H




CITY OF FULLERTON

COMMUNITY DEVELOPMENT DEPARTMENT

303 W. COMMONWEALTH AVENUE


FULLERTON CA 92832

(714) 738-6541

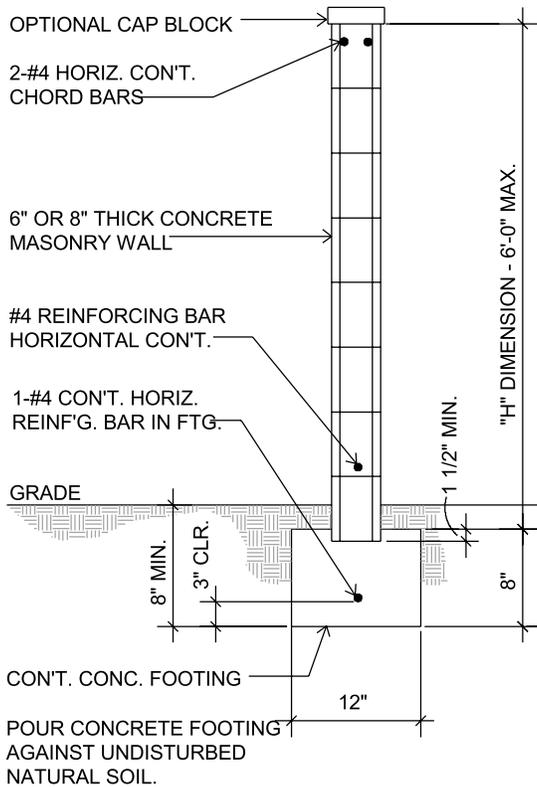


SECTION THRU WALL

"H" DIM.	PILASTER SPACING
4 FT	20' o/c
5 FT	16' o/c
6 FT	10' o/c

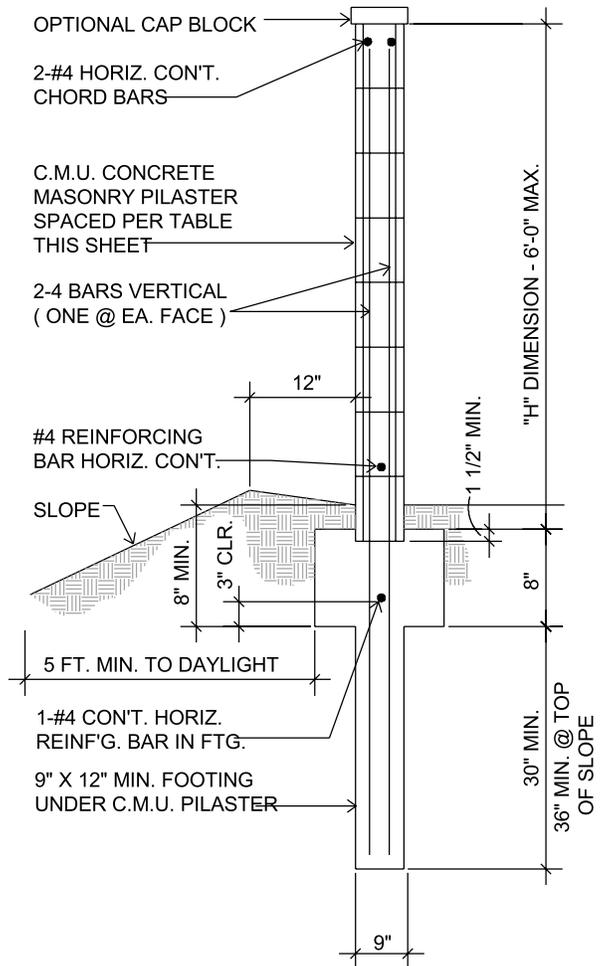

SECTION THRU PILASTER

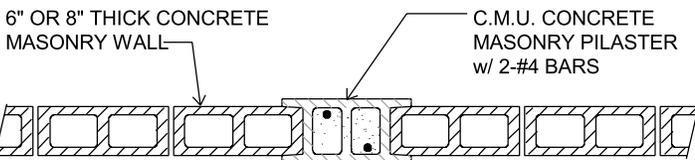

PLAN VIEW

NOTES:

1. REINF'G. SHALL BE KEPT 3" MIN. CLEAR OF EARTH. SPLICES SHALL BE LAPPED 20" MINIMUM.
2. CONCRETE AND GROUT SHALL BE MACHINE MIXED, 2,500 P.S.I. @ 28 DAY ULTIMATE COMPRESSIVE STRENGTH.
3. CONCRETE MASONRY BLOCK SHALL BE GRADE 'A' UNITS, PER A.S.T.M. C90-52.
4. FINISH GRADE SHALL BE LEVEL ABOVE & BELOW THE WALL FOR A DISTANCE EQUAL TO THE WALL HEIGHT.
5. GROUT SHALL BE 1 PART CEMENT TO 3 PARTS SAND. (MIN. 1500 P.S.I.)
6. HEAVY DUTY LADDER TYPE OR TRUSS TYPE REINFORCING (#9 BAR) MAY BE SUBSTITUTED FOR TOP CHORD BARS.
7. ALL BACKFILL SHALL BE COMPACTED TO 90% DENSITY.