



HARGIS + ASSOCIATES, INC.

HYDROGEOLOGY • ENGINEERING

La Jolla Gateway
9171 Towne Centre Drive, Suite 375
San Diego, CA 92122
Phone: 858.455.6500
Fax: 858.455.6533

January 10, 2019

VIA FEDERAL EXPRESS STANDARD

Mr. Steve Rounds
CALIFORNIA ENVIRONMENTAL PROTECTION AGENCY
DEPARTMENT OF TOXIC SUBSTANCES CONTROL
Southern California Region
9211 Oakdale Avenue
Chatsworth, CA 91311-6520

Re: Data Submittal for Groundwater Monitoring and Groundwater Extraction
and Treatment Pilot Testing, Fourth Quarter 2018, Raytheon Company (Former
Hughes Aircraft Company) Facility, 1901 West Malvern Avenue, Fullerton, California

Dear Mr. Rounds:

This letter has been prepared for the submittal of groundwater monitoring and groundwater treatment pilot testing data collected during the fourth quarter 2018 for the former Raytheon Company site located at 1901 West Malvern Avenue, Fullerton, California (the Site) (Figure 1). Groundwater monitoring activities were completed in general accordance with the California Environmental Protection Agency, Department of Toxic Substances Control (DTSC)-approved Groundwater Monitoring Work Plan and Sampling and Analysis Plan (GMWPSAP) and subsequent addenda (DTSC, 2003 and 2011; Hargis + Associates, Inc. [H+A], 2003, 2011a, and 2011b). Groundwater treatment pilot testing continued throughout the fourth quarter 2018 in general accordance with the DTSC-approved Groundwater Extraction and Treatment System (GETS) Pilot Testing, Corrective Measures Study Work Plan Addendum No. 6 (DTSC, 2013; H+A, 2013). The results of the fourth quarter 2018 groundwater monitoring and pilot GETS operation from September through November 2018 are included in this data submittal.

GROUNDWATER MONITORING

Groundwater monitoring consists of measuring groundwater levels and collecting groundwater samples from monitor wells and piezometers at the Site (Figure 2). Quarterly water level measurements were taken at all wells and piezometers, and groundwater samples were collected from extraction wells and select monitor wells in November 2018 in general accordance with the GMWPSAP and Addendum No.1 (H+A, 2003 and 2011a) (Table 1).

Other Offices:
Folsom, CA
Mesa, AZ
Tucson, AZ

Mr. Steve Rounds
January 10, 2019
Page 2

Water Level Measurement and Groundwater Sample Collection

Groundwater monitoring included water level measurements in all Site monitor wells, piezometers, and extraction wells (Figures 2 and 3). Quarterly groundwater levels were measured in all wells on November 6, 2018 (Table 2).

Groundwater samples were collected during the period from November 6 through November 8, 2018 and on November 30, 2018 (Appendix A). Analytical results are summarized in Table 3 and provided in Appendix B. Additional groundwater monitoring was conducted as part of routine operation and monitoring of the pilot GETS. A summary of the pilot GETS operation and monitoring is provided below.

Original and field-duplicate groundwater samples were analyzed by Advanced Technology Laboratories, Inc., Signal Hill, California (ATL) (Appendix B). Laboratory split groundwater samples were analyzed by Eurofins Calscience, Garden Grove, California (Appendix B). Chain-of-custody documentation was enclosed with each sample shipment. Results of groundwater sample volatile organic compound (VOC) and 1,4-dioxane analyses have been summarized (Table 3).

Additionally, samples also were collected after one and a half screen volumes were purged from three of the large-volume monitor wells during this event; these additional samples were collected to compare results between the 1.5-screen-volume purge method to the conventional three-screen-volume purge method which has been used historically at the Site for the large-volume monitor wells. Groundwater samples were collected after both 1.5- and three-screen volumes had been purged from monitor wells MW-32B, MW-33, and MW-36 (Table 3; Appendix B).

Quality Assurance/Quality Control

Quality assurance/quality control (QA/QC) samples collected in November 2018 consisted of trip blanks, field duplicates, equipment rinsate blanks, and laboratory split samples. Trip blanks were provided by ATL. Field duplicate samples were collected for analysis of VOCs and 1,4-dioxane from monitor well MW-08 and extraction well MW-21 in November 2018 (Table 3). Split samples were collected for analysis of VOCs and 1,4-dioxane from monitor well MW-08 and extraction well MW-21 in November 2018 (Table 3). The relative percent difference (RPD) was calculated between the results of each field duplicate and each laboratory split sample with its corresponding original sample. The RPD for 1,1-Dichloroethene (1,1-DCE) in groundwater samples from MW-08 was outside of acceptable limits therefore the data was qualified. Additionally, the RPD for 1,1-DCE and Trichloroethene in groundwater samples collected at MW-21 was outside of acceptable limits, therefore the data was qualified. With the exceptions mentioned above, all results for groundwater samples from monitor well MW-08 and extraction well MW-21 are within quality control criteria.

There were no detections of 1,4-dioxane and VOCs in the trip blanks and/or laboratory method blanks analyzed with groundwater samples collected during the November 2018 groundwater monitoring event (Table 3; Appendix B). Additionally, there were no detections of 1,4-dioxane or VOCs in the equipment rinsate blanks analyzed with groundwater samples collected from the November 2018 groundwater monitoring event.

The data quality assessment also included review of laboratory QA/QC results. Laboratory QA/QC results are within acceptable criteria.

Mr. Steve Rounds
January 10, 2019
Page 3

GROUNDWATER EXTRACTION AND TREATMENT PILOT STUDY

This section summarizes the pilot GETS operation within the three-month period of monitoring conducted September to November 2018. The pilot GETS consists of four groundwater extraction wells, the treatment system, and the disposal system; however, the current phase of pilot testing is operating using only two extraction wells, EW-02 and MW-29. Current extraction rates are nominally 40 gallons per minute (gpm) from extraction well EW-02 and nominally 10 gpm from extraction well MW-29. The treatment system processes extracted groundwater through an advanced oxidation unit that utilizes ultraviolet (UV) light and hydrogen peroxide (UV Ox), followed by a granular activated carbon polish prior to disposal to the sanitary sewer.

Initial startup of the pilot GETS took place in July 2008. From July 2008 through November 2009, the pilot GETS was operated with extraction wells EW-01 and MW-21 operating at approximately 10 gpm each. Pilot GETS expansion took place between November 2009 and March 2010 in order to incorporate extraction well EW-02 into the extraction well network. The system maximum flowrate was also increased from 20 gpm to 50 gpm. Beginning in March 2010, the pilot GETS was operated at 50 gpm, entirely from extraction well EW-02. During December 2011, a synthetic media pilot test was started. The purpose of the synthetic media pilot test was to evaluate the efficacy of treating water collected from extraction well MW-21 (a relatively high-concentration extraction well) using a synthetic media for contaminant removal. In order to conduct the synthetic media pilot test, extraction wells EW-02 and MW-21 were operated at approximately 40 gpm and 10 gpm, respectively. The synthetic media pilot test was completed in March 2012, and operation of the pilot GETS was restored to 50 gpm entirely from extraction well EW-02. A second phase of pilot GETS expansion took place between March 2014 and August 2014 in order to incorporate extraction well MW-29 into the extraction well network as well as replacing an advanced oxidation unit that used ozone and hydrogen peroxide with a UV Ox system. Extraction wells EW-01 and MW-21 are on standby for the current phase of pilot testing, but are planned to be used as part of a full scale pump-and-treat system.

During the fourth quarter of 2018, the pilot GETS was operational approximately 86 percent of the available runtime and approximately 3.8 million gallons of groundwater were treated and discharged to the sanitary sewer (Table 4). Downtime during the fourth quarter of 2018 was associated with operations and maintenance activities and system shutdowns due to rain events. The average operational monthly discharge flowrate to the sanitary sewer from September 2018 to November 2018 was approximately 37 gpm. Since startup of the pilot GETS, approximately 169 million gallons of groundwater was treated at an average operational flowrate of 41 gpm through the end of November 2018 (Table 4).

Current monthly and quarterly pilot GETS monitoring activities include collecting groundwater samples from extraction wells EW-02 and MW-29 in addition to collecting samples at treatment system sampling ports: Influent, Post Particulate Filter, Post UV Ox, Carbon Breakthrough, and Carbon Effluent (Tables 5 and 6; Figures 4 and 5). Samples collected during these activities were sent to ATL for analysis. Analytical results of the extraction wells and treatment system sampling have been summarized (Table 6; Appendix B).

The UV Ox advanced oxidation treatment unit is designed to remove 1,4-dioxane and most VOCs in groundwater. The carbon adsorption units provide a polish following the UV Ox treatment and remove possible low-level VOCs remaining in groundwater post UV Ox (principally low-level ethanes). The UV Ox advanced oxidation and carbon adsorption treatment units effectively removed VOCs and 1,4-dioxane from extracted groundwater in the fourth quarter 2018. The samples collected from the effluent of the UV Ox treatment unit (Post UV Ox) were analyzed for VOCs and 1,4-dioxane, and resulted in non-detect values (Table 6).

The previous oxidation treatment unit that used an ozone-peroxide technology was shown to create bromate as a treatment byproduct which occasionally exceeded the drinking water maximum contaminant level (MCL) (Figure 6). The levels of bromate previously generated as a treatment byproduct were not an issue while

Mr. Steve Rounds
January 10, 2019
Page 4


discharging to the sewer, but would preclude injection of treated groundwater back into the aquifer as part of future groundwater corrective measures. The current UV Ox oxidation treatment unit has not generated bromate above the MCL, and bromate was not detected in the Post UV Ox samples collected during the fourth quarter 2018.

The pilot GETS continues to remove VOCs and 1,4-dioxane from extracted groundwater. During the fourth quarter of 2018, the pilot GETS removed approximately 1.3 pounds of VOCs and 0.8 pounds of 1,4-dioxane from extracted groundwater. Since startup of the pilot GETS in July 2008, approximately 167 pounds of VOCs and 38 pounds of 1,4-dioxane have been removed from groundwater through November 2018 (Figure 7). Operation of the pilot GETS continues to be optimized to maximize the treatment of 1,4-dioxane and VOCs in extracted groundwater.


If you have any questions or require additional information, please contact us at 858-455-6500.

Sincerely,

HARGIS + ASSOCIATES, INC.

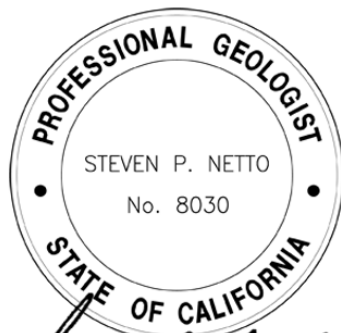A handwritten signature of Steven P. Netto in black ink.

Steven P. Netto, PG 8030, CHG 872
Senior Hydrogeologist

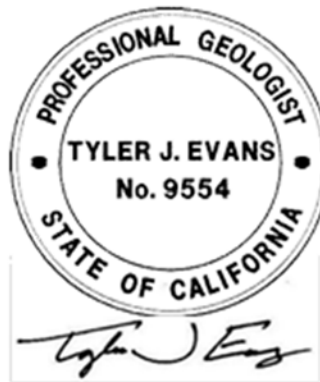A handwritten signature of Tyler J. Evans in black ink.

Tyler J. Evans, PG 9554
Hydrogeologist

A handwritten signature of Ross H. Horton in black ink.

Ross H. Horton
Engineer

SPN/TJE/RHH/jak

Mr. Steve Rounds
January 10, 2019
Page 5

REFERENCES

- California Environmental Protection Agency, Department of Toxic Substances Control (DTSC), 2003. Letter to P. Brewer, Raytheon Systems Company, from A. Plaza, DTSC, re: Review of Additional Groundwater Assessment Workplan and Groundwater Monitoring Workplan and Sampling and Analysis Plan. May 20, 2003.
- _____, 2011. Email from W. Jeffers, DTSC, re: Conditional Approval of Addendum No. 1 to the Ground Water Monitoring Work Plan, Raytheon Fullerton, dated June 7, 2011.
- _____, 2013. Email from W. Jeffers, DTSC, re: Groundwater Extraction and Treatment System Pilot Testing Corrective Measures Study Workplan, Addendum #6, dated April 16, 2013.
- Hargis + Associates, Inc. (H+A), 2003. Groundwater Monitoring Work Plan and Sampling and Analysis Plan (Revision 1.0), Raytheon Company (former Hughes Aircraft Company), 1901 West Malvern Avenue, Fullerton, California. April 25, 2003.
- _____, 2011a. Letter to W. Jeffers, DTSC, re: Addendum No. 1 to the *Groundwater Monitoring Work Plan and Sampling and Analysis Plan (Revision 1.0)*, by Hargis + Associates, Inc., dated April 25, 2003, for the Raytheon Company, (Former Hughes Aircraft Company), 1901 West Malvern Avenue, Fullerton, California. February 11, 2011.
- _____, 2011b. Letter to W. Jeffers, DTSC, re: Amendment A, Addendum No. 1 to the *Groundwater Monitoring Work Plan and Sampling and Analysis Plan (Revision 1.0)*, by Hargis + Associates, Inc., dated April 25, 2003, for the Raytheon Company, (Former Hughes Aircraft Company), 1901 West Malvern Avenue, Fullerton, California. June 16, 2011.
- _____, 2013. Groundwater Extraction and Treatment System Pilot Testing, Corrective Measures Study Workplan Addendum No. 6, Raytheon Company (former Hughes Aircraft Company), 1901 West Malvern Avenue, Fullerton, California. February 27, 2013.

Mr. Steve Rounds
January 10, 2019
Page 6

Enclosures

Tables

Table 1	Groundwater Monitoring Program
Table 2	Groundwater Levels, Fourth Quarter 2018
Table 3	Prevalent Volatile Organic Compounds and 1,4-Dioxane in Groundwater, Fourth Quarter 2018
Table 4	Pilot Groundwater Extraction and Treatment System Operational Summary
Table 5	Pilot Groundwater Extraction and Treatment System Sampling Schedule
Table 6	Select Compounds Monitored in Pilot Groundwater Extraction and Treatment System Samples, Fourth Quarter 2018

Figures

Figure 1	Site Location
Figure 2	Well and Piezometer Locations
Figure 3	Water Level and Water Quality, Unit B, November 2018
Figure 4	Pilot Groundwater Extraction and Treatment System Operation and Extraction Well Water Levels
Figure 5	1,1-Dichloroethylene and 1,4-Dioxane Concentrations in Extraction Wells
Figure 6	1,4-Dioxane and Bromate in Influent and Post-Oxidation Samples
Figure 7	Pilot Groundwater Extraction and Treatment System Mass Removal

Appendices

Appendix A	Groundwater Sampling Field Forms (Provided on CD only)
Appendix B	Laboratory Analytical Reports (Provided on CD only)

Mr. Steve Rounds
January 10, 2019
Page 7

cc w/encl: (1 copy w-CD)

Mr. Steve Rounds, Department of Toxic Substances Control, Chatsworth
Mr. Paul Pongetti, Department of Toxic Substances Control, Cypress
Mr. Paul E. Brewer, Raytheon Company
Mr. Dave Mark, Orange County Water District
Mr. Eric Silvers, Regency Centers

(2 copies w-CD)

Ms. Tiffany Foo, City of Fullerton

(CD Only)

Ms. Hye Jin Lee, City of Fullerton

(via Email) (Hard Copies Provided Upon Request)

Mr. Davin Jacobs, City of Buena Park
Ms. Iris Lee, City of Buena Park
Mr. Josh Darbee, Regency Centers
Ms. Marnie Farcone, 1st Commercial Realty Group, Inc.
Mr. Tom Shapiro, TA Realty
Mr. Kendrick Leckband, TA Realty
Ms. Christine Ehrhardt, Greystar
Ms. Mauren Hill Collins, Haley & Aldrich, Inc.
Mr. Mike McGee, City of Buena Park
Ms. Carol Owens, Greystar
Ms. Kim Buss, Orange County Public Works – Flood Control District

(via Email only)

Mr. Carl Bernhardt, California RWQCB, Santa Ana Region
Mr. Paul Rodolf, Hydraflow
Mr. Robinson Sioson, Hydraflow

TABLE 1
GROUNDWATER MONITORING PROGRAM

WELL IDENTIFIER	HYDROGEOLOGIC ZONE	SAMPLED NOV 2018	SAMPLING FREQUENCY			
			QUARTERLY FEB, MAY, AUG, NOV	SEMIANNUAL FEBRUARY, AUGUST	ANNUAL FEBRUARY	BIENNIAL FEB (EVEN YEARS)
P-07	Perched				VOCs; 1,4-Dioxane	
P-09	Perched				VOCs; 1,4-Dioxane	
MW-35A	Other					VOCs; 1,4-Dioxane
MW-17	A		PIEZOMETER - WATER LEVEL MEASUREMENT ONLY			
MW-18	A			VOCs; 1,4-Dioxane		
MW-19	A					VOCs
MW-22	A					VOCs; 1,4-Dioxane
MW-23	A					VOCs
MW-34A	A			VOCs; 1,4-Dioxane		
MW-35B	A					VOCs; 1,4-Dioxane
MW-38	A				VOCs; 1,4-Dioxane	
MW-13	AB				VOCs; 1,4-Dioxane	
MW-15	AB			VOCs		
MW-26A	AB		PIEZOMETER - WATER LEVEL MEASUREMENT ONLY			
MW-26B	AB		PIEZOMETER - WATER LEVEL MEASUREMENT ONLY			
MW-32A	AB			VOCs; 1,4-Dioxane		
EW-01	B	✗	VOCs; 1,4-Dioxane			
EW-02*	B	✗	VOCs; 1,4-Dioxane			
MW-16	B			VOCs; 1,4-Dioxane		
MW-26C	B	✗	VOCs; 1,4-Dioxane			
MW-27	B				VOCs; 1,4-Dioxane	
MW-28	B	✗	VOCs; 1,4-Dioxane			
MW-29*	B	✗	VOCs; 1,4-Dioxane			
MW-30A	B	✗	VOCs; 1,4-Dioxane			
MW-31	B	✗	VOCs; 1,4-Dioxane			
MW-32B	B	✗	VOCs; 1,4-Dioxane			
MW-33	B	✗	VOCs; 1,4-Dioxane			
MW-34B	B	✗	VOCs; 1,4-Dioxane			
MW-35C	B	✗	VOCs; 1,4-Dioxane			
MW-36	B	✗	VOCs; 1,4-Dioxane			
MW-39	B	✗	VOCs; 1,4-Dioxane			
MW-40	B	✗	VOCs; 1,4-Dioxane			
MW-41	B	✗	VOCs; 1,4-Dioxane			
MW-21	BC	✗	VOCs; 1,4-Dioxane			
MW-08	BC	✗	VOCs; 1,4-Dioxane			
MW-30B	BC	✗	VOCs; 1,4-Dioxane			
MW-34C	BC			VOCs; 1,4-Dioxane		
MW-09	C			VOCs; 1,4-Dioxane		
MW-24	C				VOCs; 1,4-Dioxane	
MW-32C	C			VOCs; 1,4-Dioxane		
MW-06	D				VOCs	
MW-20	D			VOCs; 1,4-Dioxane		
MW-25	D		WATER LEVEL MEASUREMENT ONLY			
MW-37	D				VOCs; 1,4-Dioxane	

FOOTNOTES

Groundwater Monitoring Program 2014/2015 Letter (Hargis + Associates, Inc., 2015)

* = Extraction well monitored monthly as part of the Groundwater Extraction and Treatment System Pilot Testing

VOCs = volatile organic compounds

TABLE 2
GROUNDWATER LEVELS
FOURTH QUARTER 2018

Well Identifier	Date Measured	Reference Point Elevation ^(a) (feet msl)	Depth to Water (feet btoc)	Water Level Elevation (feet msl)	Remediation System On
<u>Regional Groundwater System Monitor and Extraction Wells</u>					
MW-06	11/06/18	184.70	163.09	21.61	
MW-08	11/06/18	155.91	133.18	22.73	
MW-09	11/06/18	180.10	158.90	21.20	
MW-13	11/06/18	141.84	129.19	12.65	
MW-15	11/06/18	144.95	129.65	15.30	
MW-16	11/06/18	142.40	128.51	13.89	
MW-17	11/06/18	142.70	132.61	10.09	
MW-18	11/06/18	142.32	133.16	9.16	
MW-19	11/06/18	142.06	132.85	9.21	
MW-20	11/06/18	184.19	156.43	27.76	
MW-21	11/06/18	141.18	118.22	22.96	
MW-22	11/06/18	138.65	129.33	9.32	
MW-23	11/06/18	137.33	129.36	7.97	
MW-24	11/06/18	142.83	122.04	20.79	
MW-25	11/06/18	142.64	123.62	19.02	
MW-26A	11/06/18	137.04	123.48	13.56	
MW-26B	11/06/18	137.05	121.44	15.61	
MW-26C	11/06/18	137.22	124.60	12.62	
MW-27	11/06/18	137.16	124.26	12.90	
MW-28	11/06/18	140.77	128.31	12.46	
MW-29	09/20/18	139.81	166.90	-27.09	Pilot GETS
MW-29	10/05/18	139.81	168.92	-29.11	Pilot GETS
MW-29	10/18/18	139.81	127.00	12.81	
MW-29	11/01/18	139.81	127.78	12.03	
MW-29	11/06/18	139.81	127.88	11.93	
MW-29	11/15/18	139.81	180.96	-41.15	Pilot GETS
MW-30A	11/06/18	129.44	117.70	11.74	
MW-30B	11/06/18	129.39	114.36	15.03	
MW-31	11/06/18	119.60	107.14	12.46	
MW-32A	11/06/18	92.88	82.25	10.63	
MW-32B	11/06/18	92.89	81.51	11.38	

TABLE 2
GROUNDWATER LEVELS
FOURTH QUARTER 2018

Well Identifier	Date Measured	Reference Point Elevation ^(a) (feet msl)	Depth to Water (feet btoc)	Water Level Elevation (feet msl)	Remediation System On
<u>Reginal Groundwater System Monitor and Extraction Wells (continued)</u>					
MW-32C	11/06/18	92.88	76.20	16.68	
MW-33	11/06/18	83.19	73.45	9.74	
MW-34A	11/06/18	153.25	149.91	3.34	
MW-34B	11/06/18	153.11	141.67	11.44	
MW-34C	11/06/18	153.29	140.66	12.63	
MW-35A	11/06/18	93.57	83.41	10.16	
MW-35B	11/06/18	93.56	89.32	4.24	
MW-35C	11/06/18	93.55	82.91	10.64	
MW-36	11/06/18	86.65	77.37	9.28	
MW-37	11/06/18	155.60	142.32	13.28	
MW-38	11/06/18	154.90	153.90	1.00	
MW-39	11/06/18	84.25	75.45	8.80	
MW-40	11/06/18	123.40	109.71	13.69	
MW-41	11/06/18	155.60	144.30	11.30	
EW-01	11/06/18	141.07	126.88	14.19	
EW-02	09/20/18	132.97	123.64	9.33	Pilot GETS
EW-02	10/05/18	132.97	124.58	8.39	Pilot GETS
EW-02	10/18/18	132.97	124.65	8.32	Pilot GETS
EW-02	11/01/18	132.97	125.39	7.58	Pilot GETS
EW-02	11/06/18	132.97	125.55	7.42	Pilot GETS
EW-02	11/15/18	132.97	125.91	7.06	Pilot GETS
<u>Perched Zone Water Levels</u>					
P-07	11/06/18	142.31	112.54	29.77	
P-09	11/06/18	183.86	120.86	63.00	

FOOTNOTES

^(a) Reference point elevations are relative to City of Fullerton datum.

btoc = Below top of casing

msl = Mean sea level

Pilot GETS = Pilot Groundwater Extraction and Treatment System On

TABLE 3
PREVALENT VOLATILE ORGANIC COMPOUNDS AND 1,4-DIOXANE IN GROUNDWATER
FOURTH QUARTER 2018

Concentration (micrograms per liter)																
VOLATILE ORGANIC COMPOUNDS (FEDERAL MCL/CALIFORNIA MCL)																Semi-VOCs
Well Identifier / Sample Identifier	Date Sampled	QA Code	Benzene (5/1)	Carbon Tetrachloride (5/0.5)	Chloroform (80/80)	1,1-DCA (--/5)	1,2-DCA (5/0.5)	1,1-DCE (7/6)	cis-1,2-DCE (70/6)	PCE (5/5)	1,1,1-TCA (200/200)	1,1,2-TCA (5/5)	TCE (5/5)	TCFM (--/150)	Toluene (1,000/150)	1,4-Dioxane (3*/1**)
Regional Groundwater System Monitor and Extraction Wells																
MW-08	11/07/18	ORG	0.15 J	< 0.50	0.49 J	0.23 J	< 0.50	43 E	5.2	0.22 J	< 0.50	< 0.50	120	< 0.50	< 0.50	2.4
MW-08	11/07/18	FD	0.15 J	< 0.50	0.47 J	0.22 J	< 0.50	34 E	4.6	0.20 J	< 0.50	< 0.50	110	< 0.50	< 0.50	2.0
MW-08 ⁽¹⁾	11/07/18	SPT	0.22 J	< 0.50	0.58 J	0.29 J	< 0.50	74 E	5.4	< 1.0	< 1.0	< 1.0	170	< 10	< 1.0	2.4
MW-08 Historical Range***			< 0.50 - 0.95	< 0.50 - 0.50	< 0.50 - 0.86	< 0.50 - 5.1	< 0.50 - 0.99	< 0.50 - 500	< 0.50 - 13	< 0.50 - 1.3	< 0.50 - < 5.0	< 0.50 - < 5.0	< 0.50 - 480	< 0.50 - 1.0	< 0.50 - 2.3	< 0.20 - 130
MW-21	11/06/18	ORG	< 2.5	< 2.5	1.0 J	13 E	2.4 J	880	1.2 J	3.4	< 2.5	6.0	15 E	< 2.5	< 2.5	310
MW-21	11/06/18	FD	< 2.5	< 2.5	1.0 J	12 E	2.4 J	630	1.2 J	3.4	< 2.5	5.8	16 E	< 2.5	< 2.5	300
MW-21 ⁽²⁾	11/06/18	SPT	< 1.0	0.55	1.3	19 E	2.9	1200	1.2	3.9	< 1.0	7.8	22 E	< 10	< 1.0	200
MW-21 Historical Range***			< 0.50 - < 25	< 0.50 - 1.9	< 0.50 - 4.6	< 0.50 - 71	< 0.50 - 8.9	200 - 4,900	< 0.50 - 2.4	< 0.50 - 12	< 0.50 - 2.0	< 0.50 - 27	0.96 - 46	< 0.50 - 0.53	< 0.50 - < 10	11 - 1,100
MW-26C	11/07/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	0.41 J	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
MW-26C Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 1.7	< 0.50	< 0.50 - 120	< 0.50	< 0.50 - 0.79	< 0.50	< 0.50 - 0.77	< 0.50	< 0.50	< 0.50 - 22	< 0.20 - 57
MW-28	11/07/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
MW-28 Historical Range***			< 0.50	< 0.50	< 0.50 - 0.20 J	< 0.50 - 0.94	< 0.50	< 0.50 - 76 E	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20 - 19
MW-29	09/11/18	ORG	< 0.50	< 0.50	< 0.50	1.5	< 0.50	110	< 0.50	< 0.50	< 0.50	0.53	1.6	< 0.50	< 0.50	70
MW-29	09/20/18	ORG	< 0.50	< 0.50	< 0.50	1.4	< 0.50	120	< 0.50	0.52	< 0.50	< 0.50	1.7	0.62	< 0.50	72
MW-29	10/05/18	ORG	< 0.50	< 0.50	< 0.50	1.4	< 0.50	110	< 0.50	< 0.50	< 0.50	0.51	1.5	0.52	< 0.50	97
MW-29	11/15/18	ORG	< 0.50	< 0.50	< 0.50	1.3	< 0.50	120	< 0.50	< 0.50	< 0.50	< 0.50	1.8	< 0.50	< 0.50	140
MW-29 Historical Range***			< 0.50 - 0.57	< 0.50 - < 5.0	< 0.50 - 0.80	< 0.50 - 9.2	< 0.50 - 1.4	99 - 900 E	< 0.50 - 0.61	< 0.50 - 6.6	< 0.50 - < 5.0	< 0.50 - 2.3	0.58 - 8.3	< 0.50 - 2.2	< 0.50 - < 5.0	26 BE - 301
MW-30A	11/07/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	0.20 J	< 0.50	< 0.50	< 0.50	< 0.50	0.54	< 0.50	< 0.50	< 0.20
MW-30A Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 2.9	< 0.50 - 0.67	< 0.50 - 270	< 0.50	< 0.50 - 0.58	< 0.50	< 0.50 - 1.1	< 0.50 - 1.9	< 0.50	< 0.50	< 0.20 - 95
MW-30B	11/07/18	ORG	< 0.50	< 0.50	0.43 J	< 0.50	< 0.50	20	4.9	< 0.50	< 0.50	< 0.50	80	< 0.50	< 0.50	0.49
MW-30B Historical Range***			< 0.50	< 0.50	< 0.50 - 0.39 J	< 0.50	< 0.50	< 0.50 - 22	< 0.50 - 6.9	< 0.50	< 0.50	< 0.50	< 0.50 - 110	< 0.50	< 0.50 - 4.5	< 0.20 - 28 E
Historical High/Low																
					High											
MW-31	11/30/18	ORG	< 0.50	< 0.50	< 0.50	1.7	< 0.50	240	0.68	< 0.50	< 0.50	< 0.50	11	< 0.50	< 0.50	8.8
MW-31 Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 3.7	< 0.50	25 - 430	< 0.50 - 1.2	< 0.50 - 2.5	< 0.50	< 0.50 - 1.2	0.50 - 21	< 0.50	< 0.50 - 1.0	< 0.20 - 16
MW-32B_1.5SV	11/07/18	ORG	< 0.50	< 0.50	< 0.50	1.5	< 0.50	130	4.5	< 0.50	< 0.50	< 0.50	53	< 0.50	< 0.50	5.2
MW-32B	11/07/18	ORG	< 0.50	< 0.50	< 0.50	1.3	< 0.50	140	3.9	< 0.50	< 0.50	< 0.50	45	< 0.50	< 0.50	6.9
MW-32B Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 1.4	< 0.50	16 - 180	1.9 - 5.9	< 0.50	< 0.50	< 0.50	20 - 75	< 0.50	< 0.50	0.39 - 4.6
Historical High/Low																
					High											
MW-33_1.5SV	11/07/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	3.1	< 0.50	0.27 J	< 0.50	< 0.50	0.20 J	< 0.50	< 0.50	< 0.20
MW-33	11/07/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	3.2	< 0.50	0.32 J	< 0.50	< 0.50	0.19 J	< 0.50	< 0.50	< 0.20
MW-33 Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	1.7 - 12	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50 - 2.0	< 0.50	< 0.50 - 1.4	< 0.20 - < 2.0
Historical High/Low																
					High											

TABLE 3
PREVALENT VOLATILE ORGANIC COMPOUNDS AND 1,4-DIOXANE IN GROUNDWATER
FOURTH QUARTER 2018

			Concentration (micrograms per liter)													
			VOLATILE ORGANIC COMPOUNDS (FEDERAL MCL/CALIFORNIA MCL)												Semi-VOCs	
Well Identifier / Sample Identifier	Date Sampled	QA Code	Benzene (5/1)	Carbon Tetrachloride (5/0.5)	Chloroform (80/80)	1,1-DCA (--/5)	1,2-DCA (5/0.5)	1,1-DCE (7/6)	cis-1,2-DCE (70/6)	PCE (5/5)	1,1,1-TCA (200/200)	1,1,2-TCA (5/5)	TCE (5/5)	TCFM (--/150)	Toluene (1,000/150)	1,4-Dioxane (3*/1**)
<u>Regional Groundwater System Monitor and Extraction Wells (continued)</u>																
MW-34B	11/07/18	ORG	< 0.50	< 0.50	< 0.50	0.43 J	< 0.50	35	< 0.50	0.21 J	< 0.50	0.20 J	0.19 J	< 0.50	< 0.50	17
MW-34B Historical Range***			< 0.50 - < 5.0	< 0.50 - < 5.0	< 0.50 - 0.50	< 0.50 - 9.8	< 0.50 - 1.4	20 E - 1,100	< 0.50 - < 5.0	< 0.50 - 1.1	< 0.50 - 1.0	< 0.50 - 2.6	< 0.50 - 2.1	< 0.50 - < 5.0	< 0.50 - 2.6	< 2.0 E - 196
MW-35C	11/08/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
MW-35C Historical Range***			< 0.50	< 0.50	< 0.50 - 120	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20 - < 2.0
MW-36_1.5SV	11/08/18	ORG	< 0.50	< 0.50	< 0.50	0.5	< 0.50	47	< 0.50	< 0.50	< 0.50	0.12 J	< 0.50	< 0.50	< 0.50	6.8
MW-36	11/08/18	ORG	< 0.50	< 0.50	< 0.50	0.54	< 0.50	52	< 0.50	< 0.50	< 0.50	0.14 J	< 0.50	< 0.50	< 0.50	7.3
MW-36 Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 1.7	< 0.50	2.9 - 150	< 0.50	< 0.50	< 0.50	< 0.50 - 0.24 J	< 0.50	< 0.50	< 0.50 - 5.9	< 0.20 - 15
MW-39	11/08/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
MW-39 Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50 - 1.4	< 0.20 - < 2.0
MW-40	11/08/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
MW-40 Historical Range***			< 0.50	< 0.50	< 0.50 - 0.60	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20 - < 2.0
MW-41	11/08/18	ORG	< 0.50	< 0.50	0.43 J	0.21 J	< 0.50	21	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	7.7
MW-41 Historical Range***			< 0.50	< 0.50	< 0.50 - 0.73	< 0.50 - 1.3	< 0.50	< 0.50 - 130	< 0.50	< 0.50 - 0.20 J	< 0.50	< 0.50 - 0.39 J	< 0.50 - 110	< 0.50	< 0.50	< 0.20 - 18
EW-01	11/06/18	ORG	< 0.50	< 0.50	< 0.50	1.3	< 0.50	81	< 0.50	< 0.50	< 0.50	< 0.50	0.39 J	< 0.50	< 0.50	55
EW-01 Historical Range***			< 0.50 - 2.0	< 0.50 - 0.55	< 0.50 - 1.2	< 0.50 - 16	< 0.50 - 4.0	< 0.50 - 1,600 E	< 0.50 - 0.52	< 0.50 - 4.3	< 0.50 - < 2.5	< 0.50 - 10	< 0.50 - 3.3	< 0.50 - 0.61	< 0.50 - 4.6	< 2.0 - 990 E
EW-02	09/11/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	13	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 2.0
EW-02	09/20/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	12	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	7.0
EW-02	10/05/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	11	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	9.0
EW-02	10/18/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	11	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	6.3
EW-02	11/01/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	12	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	7.5
EW-02	11/15/18	ORG	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	17	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	8.4
EW-02 Historical Range***			< 0.50	< 0.50	< 0.50	< 0.50 - 1.5	< 0.50	2.3 - 160	< 0.50	< 0.50	< 0.50	< 0.50 - 0.59	< 0.50	< 0.50	< 0.50 - 0.85	< 2.0 - 48
<u>Quality Assurance/Quality Control Samples</u>																
TB-091118	09/11/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-092018	09/20/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-100518	10/05/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-101818	10/18/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-110118	11/01/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-110618A	11/06/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-110618B	11/06/18	TB-SPT	< 1.0	< 0.50	< 1.0	< 1.0	< 0.50	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 10	< 1.0	NA
RB-110718	11/07/18	RB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.20
TB-110818	11/08/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-111518	11/15/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA
TB-113018	11/30/18	TB	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	< 0.50	NA

TABLE 3
PREVALENT VOLATILE ORGANIC COMPOUNDS AND 1,4-DIOXANE IN GROUNDWATER
FOURTH QUARTER 2018

		Concentration (micrograms per liter).....													
			VOLATILE ORGANIC COMPOUNDS (FEDERAL MCL/CALIFORNIA MCL)												Semi-VOCs	
Well Identifier / Sample Identifier	Date Sampled	QA Code	Benzene (5/1)	Carbon Tetrachloride (5/0.5)	Chloroform (80/80)	1,1-DCA (--/5)	1,2-DCA (5/0.5)	1,1-DCE (7/6)	cis-1,2-DCE (70/6)	PCE (5/5)	1,1,1-TCA (200/200)	1,1,2-TCA (5/5)	TCE (5/5)	TCFM (--/150)	Toluene (1,000/150)	1,4-Dioxane (3*/1**)

NOTE: Detections are shown in **BOLD** type.

- (1) 1,1,2-Trichloro-1,2,2-Trifluoroethane was detected at a concentration of 2.2 J ug/L in the split sample for monitor well MW-08 collected on 11/07/18
- (2) 1,1,2-Trichloro-1,2,2-Trifluoroethane was detected at a concentration of 4.8 J ug/L in the split sample for monitor well MW-21 collected on 11/06/18

FOOTNOTES

1,1-DCA = 1,1-Dichloroethane
1,2-DCA = 1,2-Dichloroethane
1,1-DCE = 1,1-Dichloroethene
cis-1,2-DCE = cis-1,2-Dichloroethene
PCE = Tetrachloroethene
1,1,1-TCA = 1,1,1-Trichloroethane
1,1,2-TCA = 1,1,2-Trichloroethane
TCE = Trichloroethene

TCFM = Trichlorofluoromethane
(<) = Less than; the value is the Limit of Detection for that compound
* = 1,4-Dioxane Action Level of 3 ug/l
** = California Notification Level for 1,4-Dioxane of 1 ug/l
*** = Historical Range determined using original samples exclusively
Semi-VOCs = Semivolatile organic compounds
NA = Not analyzed for constituent
FD = Field duplicate sample

ug/l = Micrograms per liter
MCL = Maximum Contaminant Level
ORG = Original sample
TB = Trip blank sample
B = Analyte detected in associated Method Blank
E = Data qualified as Estimated in accordance with quality control criteria
J = Estimated Value; analyte detected at less than the Reporting Limit and greater than or equal to the Method Detection Limit

QA = Quality Assurance
SPT = Split sample
ug/l = micrograms per liter
RB = Rinsate blank sample

TABLE 4
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM OPERATIONAL SUMMARY

OPERATIONAL PERIOD (MONTH/QUARTER/YEAR)	WELLFIELD PRODUCTION ^(a) (gallons)	AVERAGE DISCHARGE RATE ^(b) (gpm)	AVERAGE OPERATIONAL DISCHARGE RATE ^(c) (gpm)	OPERATIONAL HOURS DURING OPERATIONAL PERIOD	HOURS IN OPERATIONAL PERIOD	% OPERATIONAL
2008^(d)	3,659,562	13.8	18.2	3,358	4,416	76%
Jul-05	5,787,848	11.0	18.1	5,319	8,760	61%
Jul-05	14,295,261	27.2	46.4	5,131	8,760	59%
Jul-05	20,456,899	38.9	45.8	7,442	8,760	85%
2012^(e)	19,378,122	40.2	47.2	6,850	8,040	85%
2013^(f)	21,148,029	40.2	45.7	7,713	8,760	88%
2014^(g)	7,690,471	14.6	46.8	2,740	8,760	31%
2015^(h)	18,019,312	34.3	47.9	6,275	8,760	72%
2016⁽ⁱ⁾	21,977,404	41.8	44.2	8,284	8,736	95%
2017^(j)	18,364,603	34.6	39.8	7,684	8,835	87%
Dec-17	1,738,056	38.8	38.8	746	748	100%
Jan-18	1,170,609	29.0	40.7	479	672	71%
Feb-18	1,571,156	26.0	40.3	650	1,007	65%
1Q2018	4,479,821	30.8	39.8	1,875	2,426	77%
Mar-18	1,186,739	39.5	39.5	501	501	100%
Apr-18	1,564,425	38.4	38.8	672	679	99%
May-18	1,882,418	37.4	38.1	823	838	98%
2Q2018	4,633,582	38.3	38.7	1,996	2,018	99%
Jun-18	1,515,799	37.9	38.4	658	667	99%
Jul-18	1,509,065	37.4	37.5	671	672	100%
Aug-18	2,202,004	38.2	38.2	959	961	100%
3Q2018	5,226,868	37.9	38.1	2,288	2,300	100%
Sep-18	1,370,782	39.7	39.7	575	576	100%
Oct-18	1,146,548	29.5	35.2	543	648	84%
Nov-18	1,287,234	27.1	35.1	612	793	77%
4Q2018	3,804,564	31.4	36.7	1,730	2,017	86%
SINCE INCEPTION	168,922,346	30.8	41.0	68,685	91,347	75%

Notes:

(a) Based on Effluent totalizer readings from the Carbon Effluent, which also includes relatively small amounts of monitor well purge water from quarterly sampling events, well installations, and aquifer testing.

(b) Total volume of water treated during the operational period divided by the total number of minutes in that operational period.

(c) Total volume of water treated during the operational period divided by the minutes of operation in that operational period.

(d) Operational period beginning 7/1/2008 (first month of system operation).

(e) 2012 Calendar year is from 1/1/2012 through 11/30/2012.

(f) 2013 Calendar year is from 12/1/2012 through 11/30/2013.

(g) 2014 Calendar year is from 12/1/2013 through 11/30/2014.

(h) 2015 Calendar year is from 12/1/2014 through 11/30/2015.

(i) 2016 Calendar year is from 12/1/2015 through 11/30/2016.

(j) 2017 Calendar year is from 12/1/2016 through 11/30/2017.

gpm = gallons per minute

Refer to previous quarterly reports for detail of 2008 through 2017 operational summary.

Treatment of groundwater from extraction well EW-02 initiated in 2010.

Treatment of groundwater from monitor well MW-29 initiated in 2014.

TABLE 5
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM SAMPLING SCHEDULE

COMPOUND(S) / CONSITITUENT				ANALYTICAL METHOD				SAMPLE CONTAINER				REPORTING DETECTION LIMITS (milligrams per liter)				SAMPLE FREQUENCY AND LOCATION																							
																Daily Samples ¹ : Days 1-5					Weekly Samples ¹ : Weeks 1-4					Monthly Samples: Week 5+					Quarterly Samples: Week 1+								
																System Influent (INF)	Post-Filter (PF)	Post-Oxidation (POX)	Carbon Breakthrough (CBT) ³	Post-Carbon (CEFF)	System Influent (INF)	Post-Filter (PF)	Post-Oxidation (POX)	Carbon Breakthrough (CBT) ³	Post-Carbon (CEFF)	Extraction Wells (Well ID) ²	System Influent (INF)	Post-Filter (PF)	Post-Oxidation (POX)	Carbon Breakthrough (CBT) ³	Post-Carbon (CEFF)	Extraction Wells (Well ID) ²	System Influent (INF)	Post-Oxidation (POX)	Post-Carbon (CEFF)				
COMPOUNDS/CONSTITUENTS NORMALLY REQUIRED AS PART OF NPDES OR WDR PERMITS, PURSUANT TO CRWQCB REGION 8 ORDER NO. R8-2003-0085																																							
Volatile Organic Compounds	EPA 8260B	3 - 40 mL VOA, HCl	QAPP ⁴	X		X	X	X		X		X	X	X		X	X		X	X	X																		
1,4-Dioxane	EPA 8270 Modified	1 L Amber	0.002	X						X						X	X																						
1,4-Dioxane	EPA 8270 SIM	1 L Amber	0.0002			X						X							X																				
Total Suspended Solids	SM2540D	250 mL poly	10														X																						
Total Dissolved Solids	SM2540C	250 mL poly	10																					X	X	X	X												
SELECTED METALS																																							
Dissolved Metals (Iron, Manganese, Calcium, Sodium, Magnesium)	EPA 6010B	500 mL poly	QAPP ⁴	(a)																				X	X														
Selenium	EPA 6010B	500 mL poly, HNO ₃	QAPP ⁴																				X	X															
SELECTED INORGANIC CONSTITUENTS																																							
Hydroxide Alkalinity	SM2320B	250 mL poly	2.0	(a)														X	X					X	X														
Bicarbonate Alkalinity	SM2320B	250 mL poly	2.0	(a)														X	X					X	X														
Carbonate Alkalinity	SM2320B	250 mL poly	2.0	(a)														X	X					X	X														
Total Alkalinity	SM2320B	250 mL poly	2.0	(a)														X	X					X	X														
BROMATE EVALUATION																																							
Bromate	EPA 317.0	125 mL poly	0.0005			X						X							X																				
Bromide	EPA 300.0	125 mL poly	0.05	(a)						(a)							X	X																					
OTHER CONSTITUENTS/COMPOUNDS																																							
Total Organic Carbon	SM5310B	3 - 40 mL VOA, HCl	3.0	(a)														X	X					X	X	X													
Anions (Chloride, Sulfate, Nitrate, Nitrite, and Phosphate)	EPA 300.0	500 mL poly	Varies	(a)																				X	X	X													
Chemical Oxygen Demand	EPA 410.4	125 mL poly, H ₂ SO ₄	5.0	(a)																				X	X	X													
UV Absorption (UVA) @254nm	EPA 415.3	250 mL Amber	N/A		(a)												X						X	X	X														
Field Parameters																																							
Dissolve Oxygen (DO)	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
Electrical Conductance (EC)	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
Redox Potential	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
Temperature	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
pH	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
Turbidity	N/A	N/A	N/A	X	X	X	X	X		X	X	X	X	X		X	X	X	X	X	X																		
Flow-Meter	N/A	N/A	N/A	X				X		X				X		X	X																						
Residual Hydrogen Peroxide	N/A	N/A	N/A			(a)	(a)	(a)				X	X	X					X	X	X																		

TABLE 5
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM SAMPLING SCHEDULE

FOOTNOTES

(a) Only one sample to be collected during sampling period.

1 Daily and weekly samples collected during the first month of operation will be repeated after major modifications to system equipment or operating parameters, as detailed in the Workplan.

2 If more than one extraction well is in operation, combined influent samples will be collected in addition to extraction wellhead samples, with the same sampling schedule as the extraction wellheads.

3 Carbon breakthrough will be collected from the effluent of the first carbon unit in series; when breakthrough of the first unit is detected, the breakthrough sample will be collected from the effluent of the second carbon unit in series.

4 QAPP, Quality Assurance Project Plan, Appendix B of Additional Groundwater Assessment Workplan, Hargis + Associates, Inc., April 25, 2003.

CRWQCB = California Regional Water Quality Control Board, Santa Ana Region 8

NPDES = National Pollutant Discharge Elimination System

WDR = Waste Discharge Requirement

N/A = Not applicable

mL = Milliliter

VOA = Volatile organic analysis

HCl = Hydrochloric acid

HNO₃ = Nitric acid

H₂SO₄ = Sulfuric acid

nm = Nanometers

EPA = U.S. Environmental Protection Agency

SIM = Selected ion monitoring

SM = Standard Method

L = Liter

poly = High density polyethylene bottle

Amber = Amber glass bottle

TABLE 6
SELECT COMPOUNDS MONITORED IN
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM SAMPLES
FOURTH QUARTER 2018

Compound	Date	Units	MW-21 ^(a)	MW-29	EW-01 ^(a)	EW-02	INF*	PF	POX	CBT	CEFF
Extraction Rate	9/1/18-11/30/18	gpm	0	10	0	40	--	--	--	--	--
1,1,2-Trichloroethane (5 ug/L MCL)	09/11/18	ug/L	--	0.53	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	0.51	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
1,1-Dichloroethane (5 ug/L MCL)	09/11/18	ug/L	--	1.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	1.4	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	1.4	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	1.3	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
1,1-Dichloroethene (6 ug/L MCL)	09/11/18	ug/L	--	110	--	13	34	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	120	--	12	35	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	110	--	11	33	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	11	11	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	12	12	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	120	--	17	52	--	<0.5	<0.5	<0.5
1,2-Dichloroethane (0.5 ug/L MCL)	09/11/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
cis-1,2-Dichloroethene (6 ug/L MCL)	09/11/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
Tetrachloroethene (5 ug/L MCL)	09/11/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	0.52	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	<0.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
Trichloroethene (5 ug/L MCL)	09/11/18	ug/L	--	1.6	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	09/20/18	ug/L	--	1.7	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/05/18	ug/L	--	1.5	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	10/18/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/01/18	ug/L	--	--	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
	11/15/18	ug/L	--	1.8	--	<0.5	<0.5	--	<0.5	<0.5	<0.5
1,4-Dioxane (1 ug/L California Notification Level)	09/11/18	ug/L	--	70	--	<2.0	21	--	<0.2	<0.2	<0.2
	09/14/18	ug/L	200	--	41	--	--	--	--	--	--
	09/20/18	ug/L	--	72	--	7	18	--	<0.2	<0.2	<0.2
	10/05/18	ug/L	--	97	--	9	22	--	<0.2	<0.2	<0.2
	10/18/18	ug/L	--	--	--	6.3	8	--	<0.2	<0.2	<0.2
	11/01/18	ug/L	--	--	--	7.5	7.5	--	<0.2	<0.2	<0.2
	11/15/18	ug/L	--	140	--	8.4	35	--	<0.2	<0.2	<0.2
Bromide	09/11/18	mg/L	--	0.47	--	0.26	0.3	--	--	--	--
	10/05/18	mg/L	--	0.66	--	0.32	0.37	--	--	--	--
	11/01/18	mg/L	--	--	--	0.26	0.26	--	--	--	--

TABLE 6
SELECT COMPOUNDS MONITORED IN
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM SAMPLES
FOURTH QUARTER 2018


Compound	Date	Units	MW-21 ^(a)	MW-29	EW-01 ^(a)	EW-02	INF*	PF	POX	CBT	CEFF
Bromate	09/11/18	ug/L	--	--	--	--	< 0.5	--	< 0.5	--	--
	10/05/18	ug/L	--	--	--	--	< 0.5	--	< 0.5	--	--
	11/01/18	ug/L	--	--	--	--	< 0.5	--	< 0.5	--	--
Total Non-Filterable-Residue (10 ug/L MCL)	09/11/18	mg/L	--	--	--	--	--	< 1.0	--	--	--
	10/05/18	mg/L	--	--	--	--	--	< 1.0	--	--	--
	11/01/18	mg/L	--	--	--	--	--	< 1.0	--	--	--
Total Filterable Residue (500 mg/L MCL)	09/11/18	mg/L	--	810	--	650	680	--	670	--	670

NOTE: Detections are shown in **BOLD** type.

FOOTNOTES:

^(a) = inactive extraction wells; extraction wells MW-21 and EW-01 operated from July 2008 to November 2009
MCL = Maximum Contaminant Level or Drinking Water Action Level, if applicable
ug/L = micrograms per liter
mg/L = milligrams per liter
gpm = gallon per minute
(--)= Not scheduled for performance monitoring
(<) = Less than; the numerical value is the Limit of Detection for that compound
INF* = Influent (extraction wells EW-02 and MW-29)
PF = Post Particulate Filter
POX = Post UV/Chem-Ox
CBT = Carbon Breakthrough
CEFF = Carbon Effluent

May 11, 2011 - 10:09am ADE - T: \2011\500-599\532 Raytheon\Hydrogeology\H+A Base\Maps\410-8281.dwg

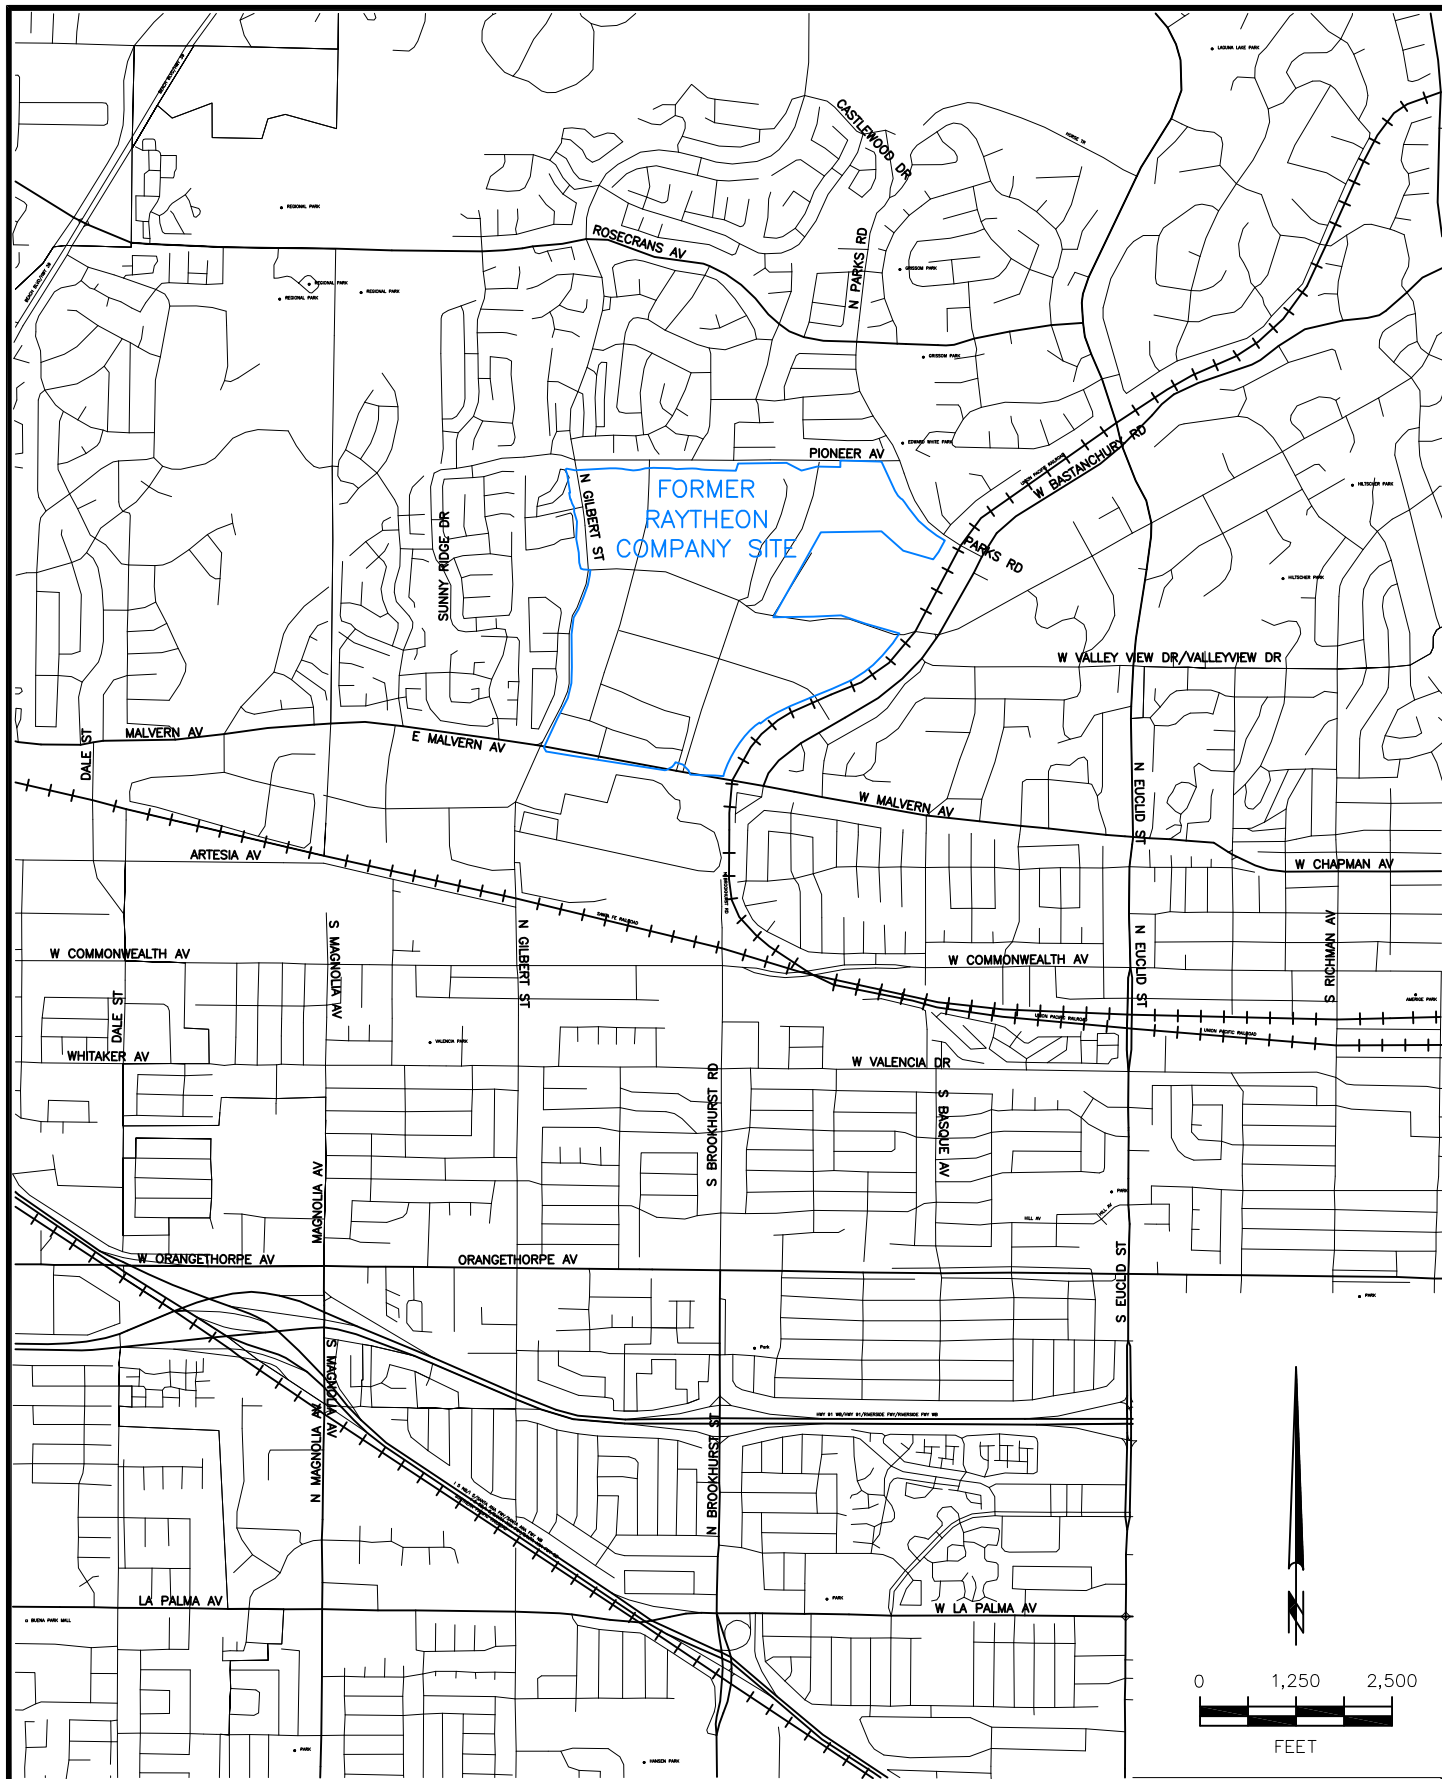

HARGIS+ASSOCIATES, INC.
Hydrogeology/Engineering

FIGURE 1. SITE LOCATION

5/11 | RPT NO. 532.31 | 410-8281 | A

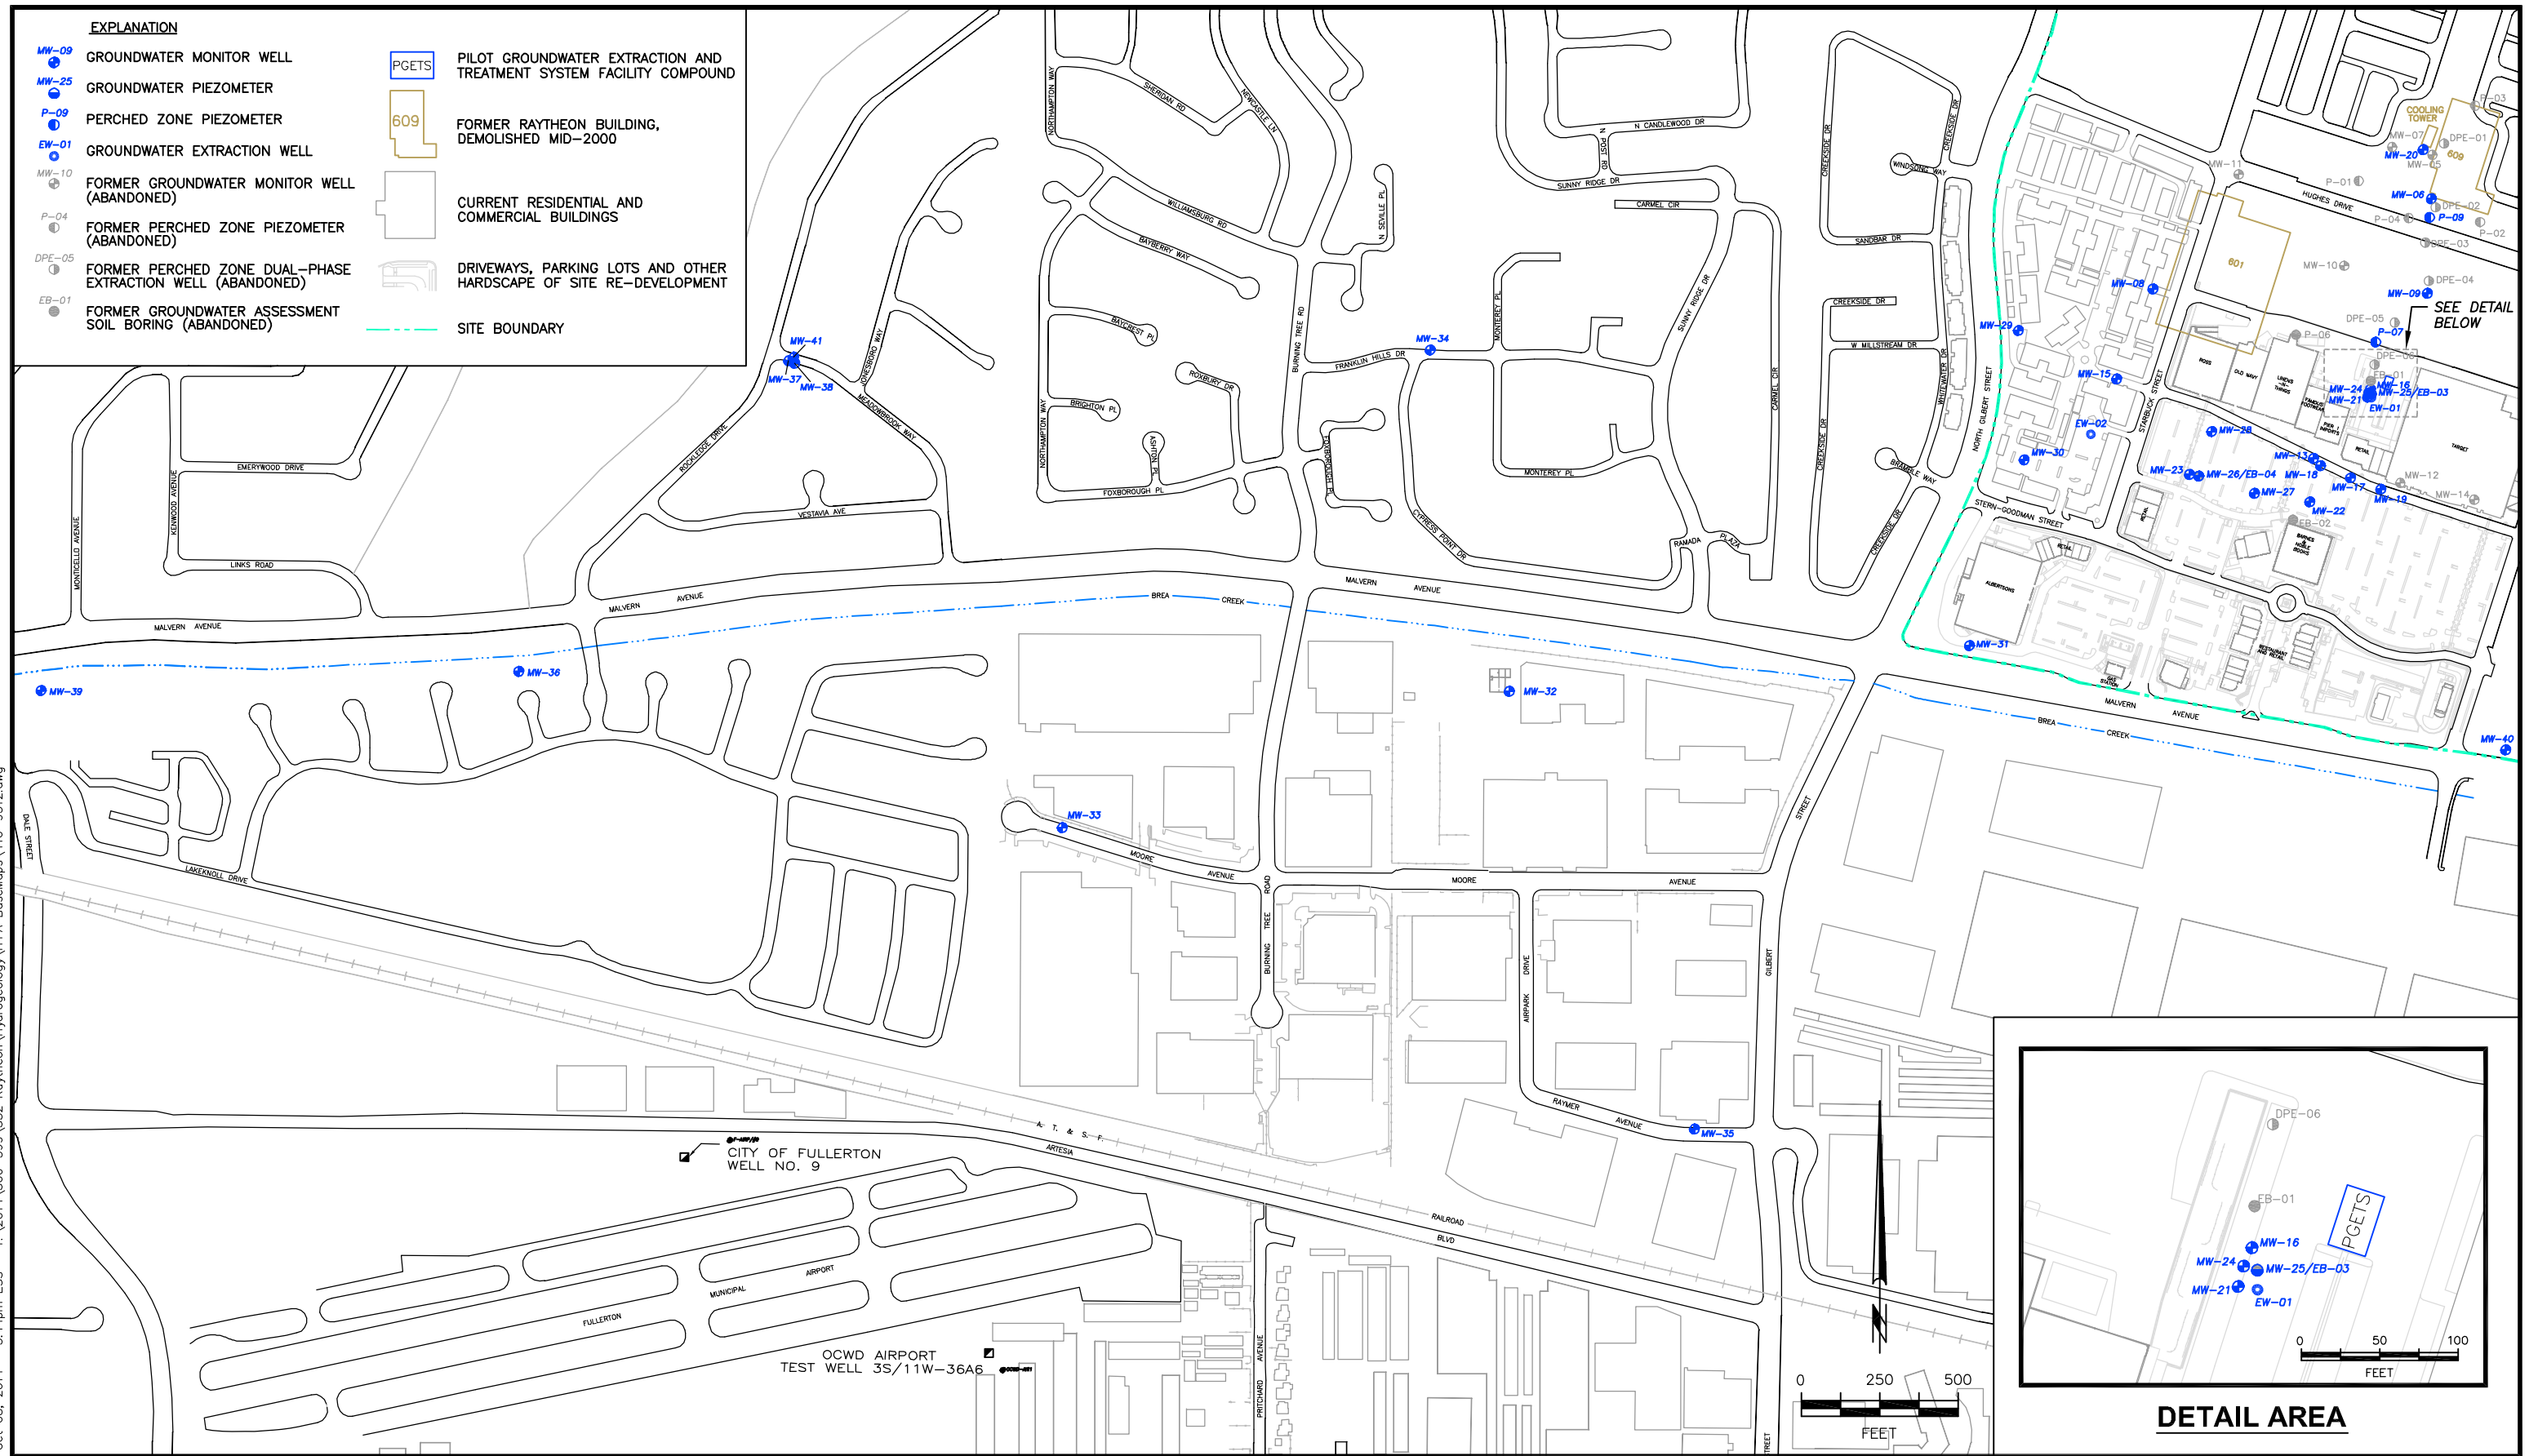


FIGURE 2.
WELL AND PIEZOMETER LOCATIONS

Jan 04, 2019 - 11:31am ESS - T:\2019\500-599\532 Raytheon\Hydrogeology\Water Lvl\220-2460.dwg

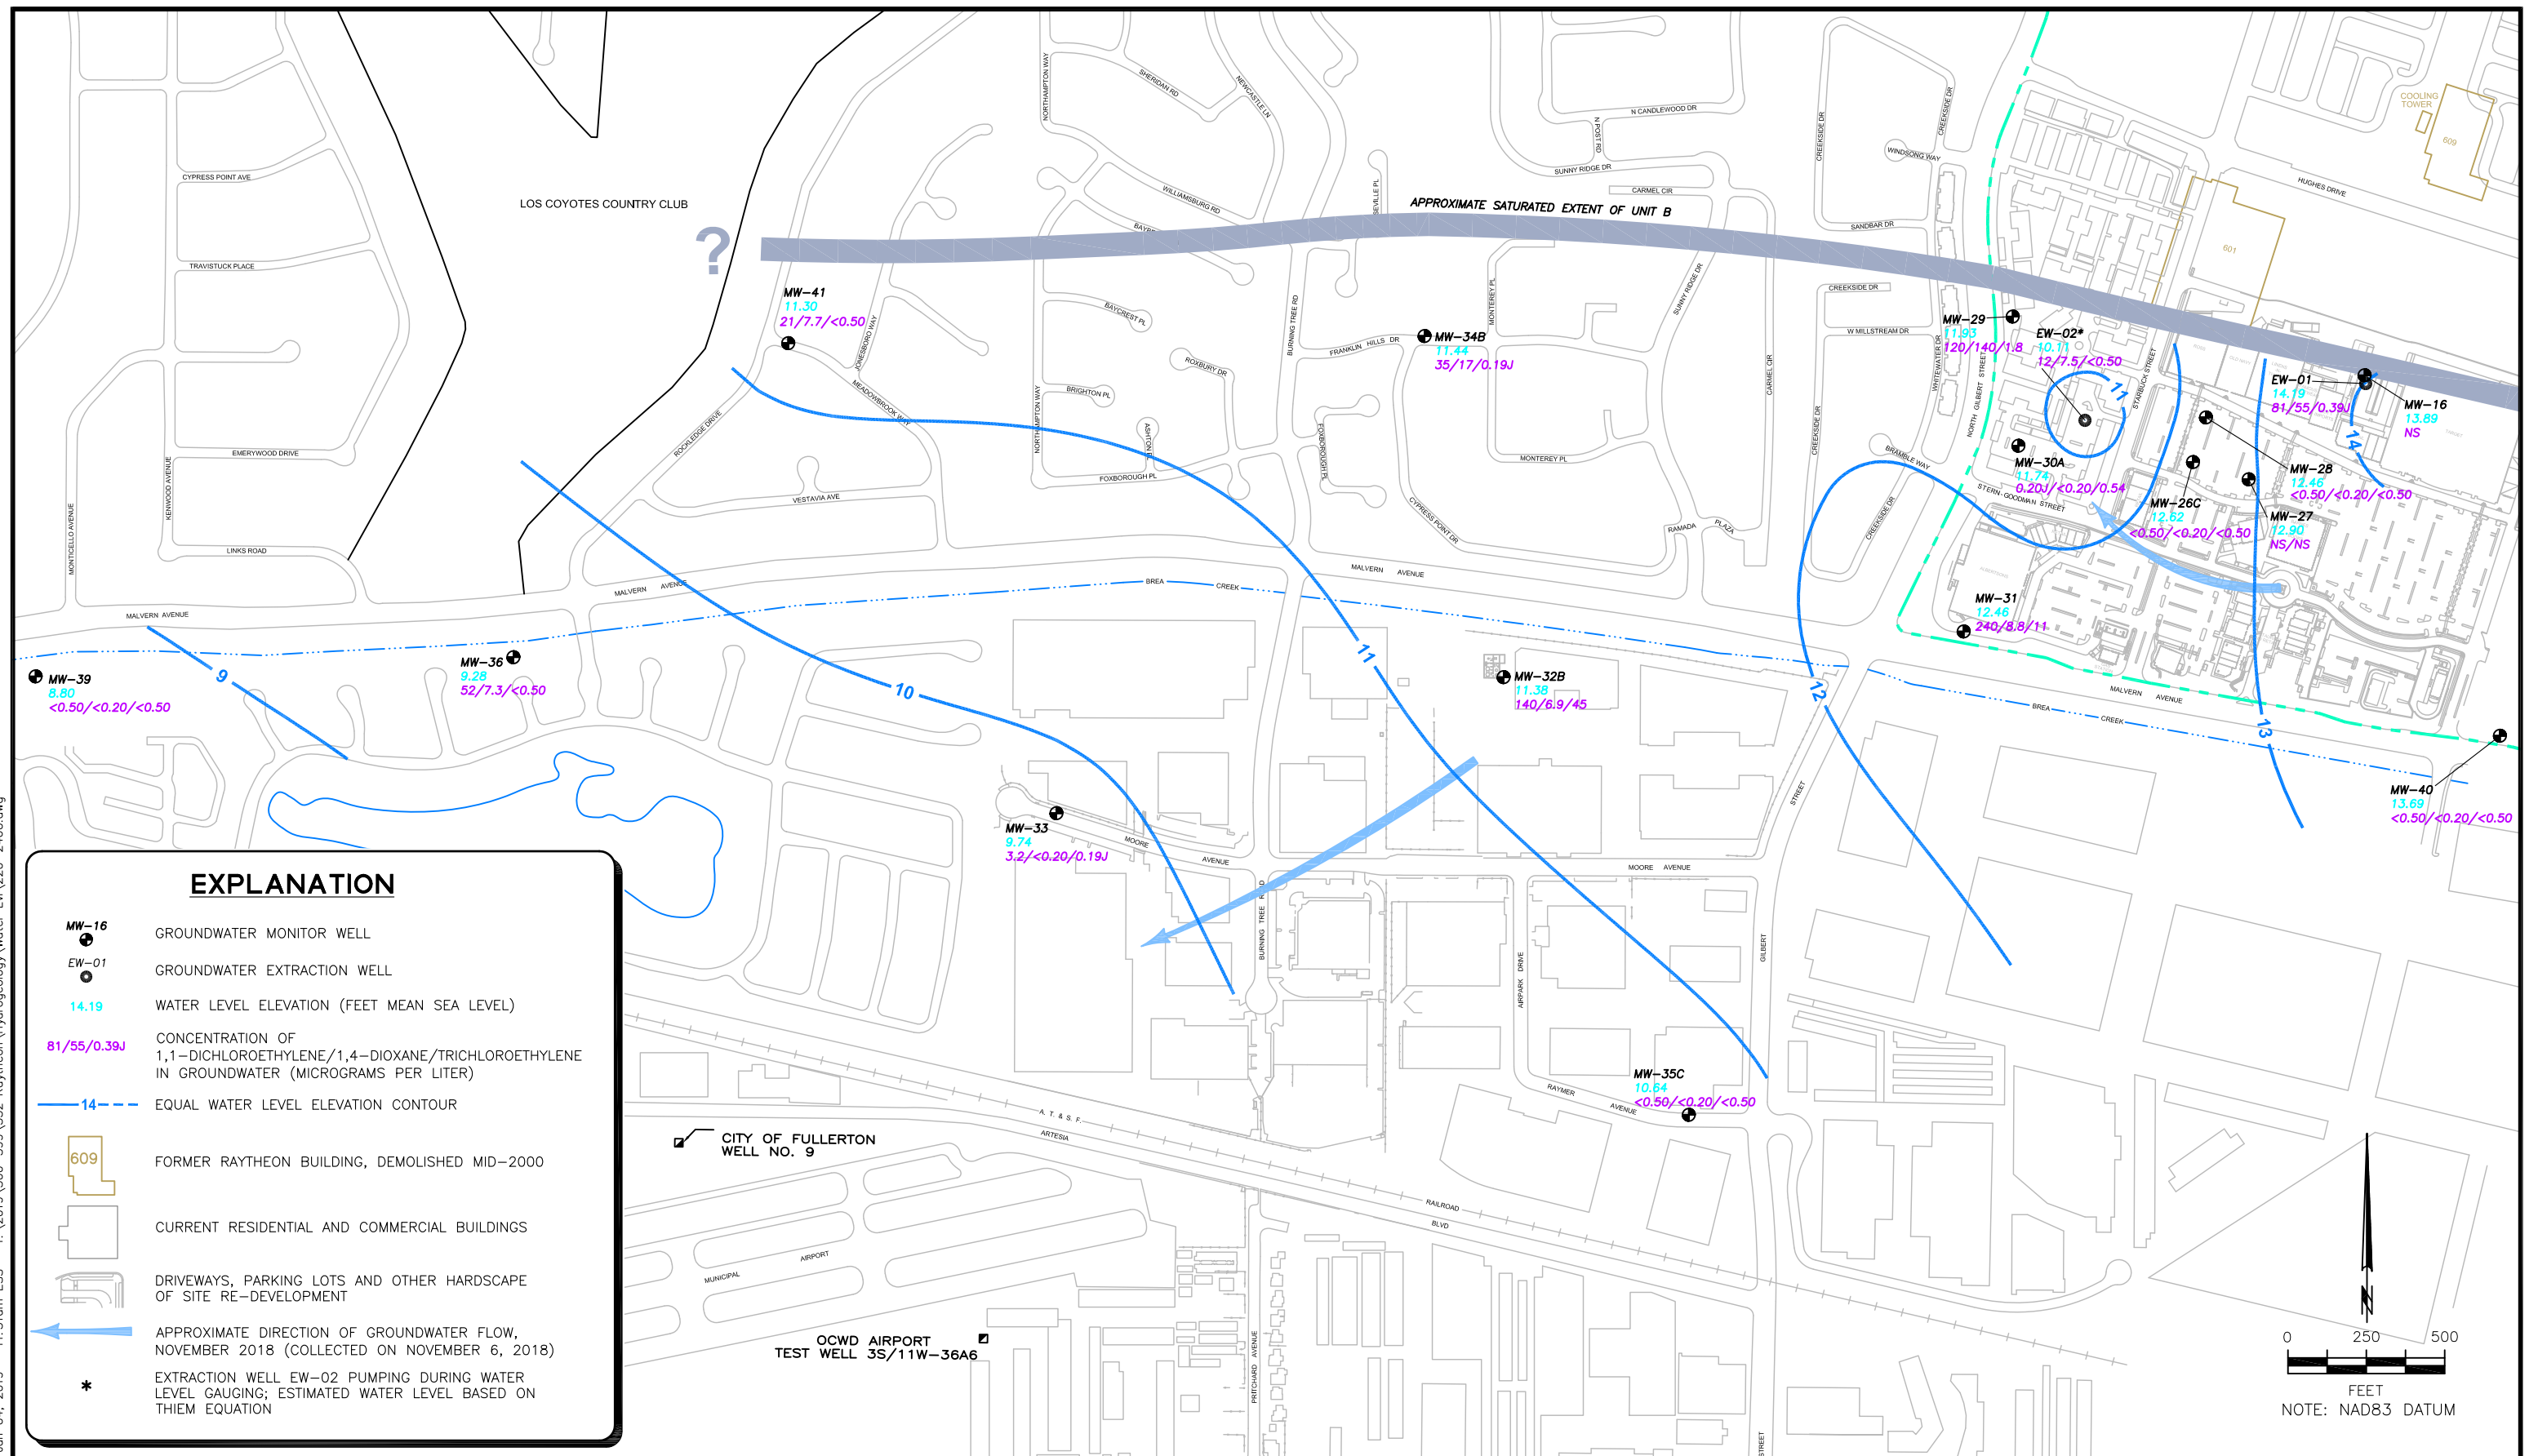


FIGURE 3.
WATER LEVEL AND WATER QUALITY UNIT B
NOVEMBER 2018

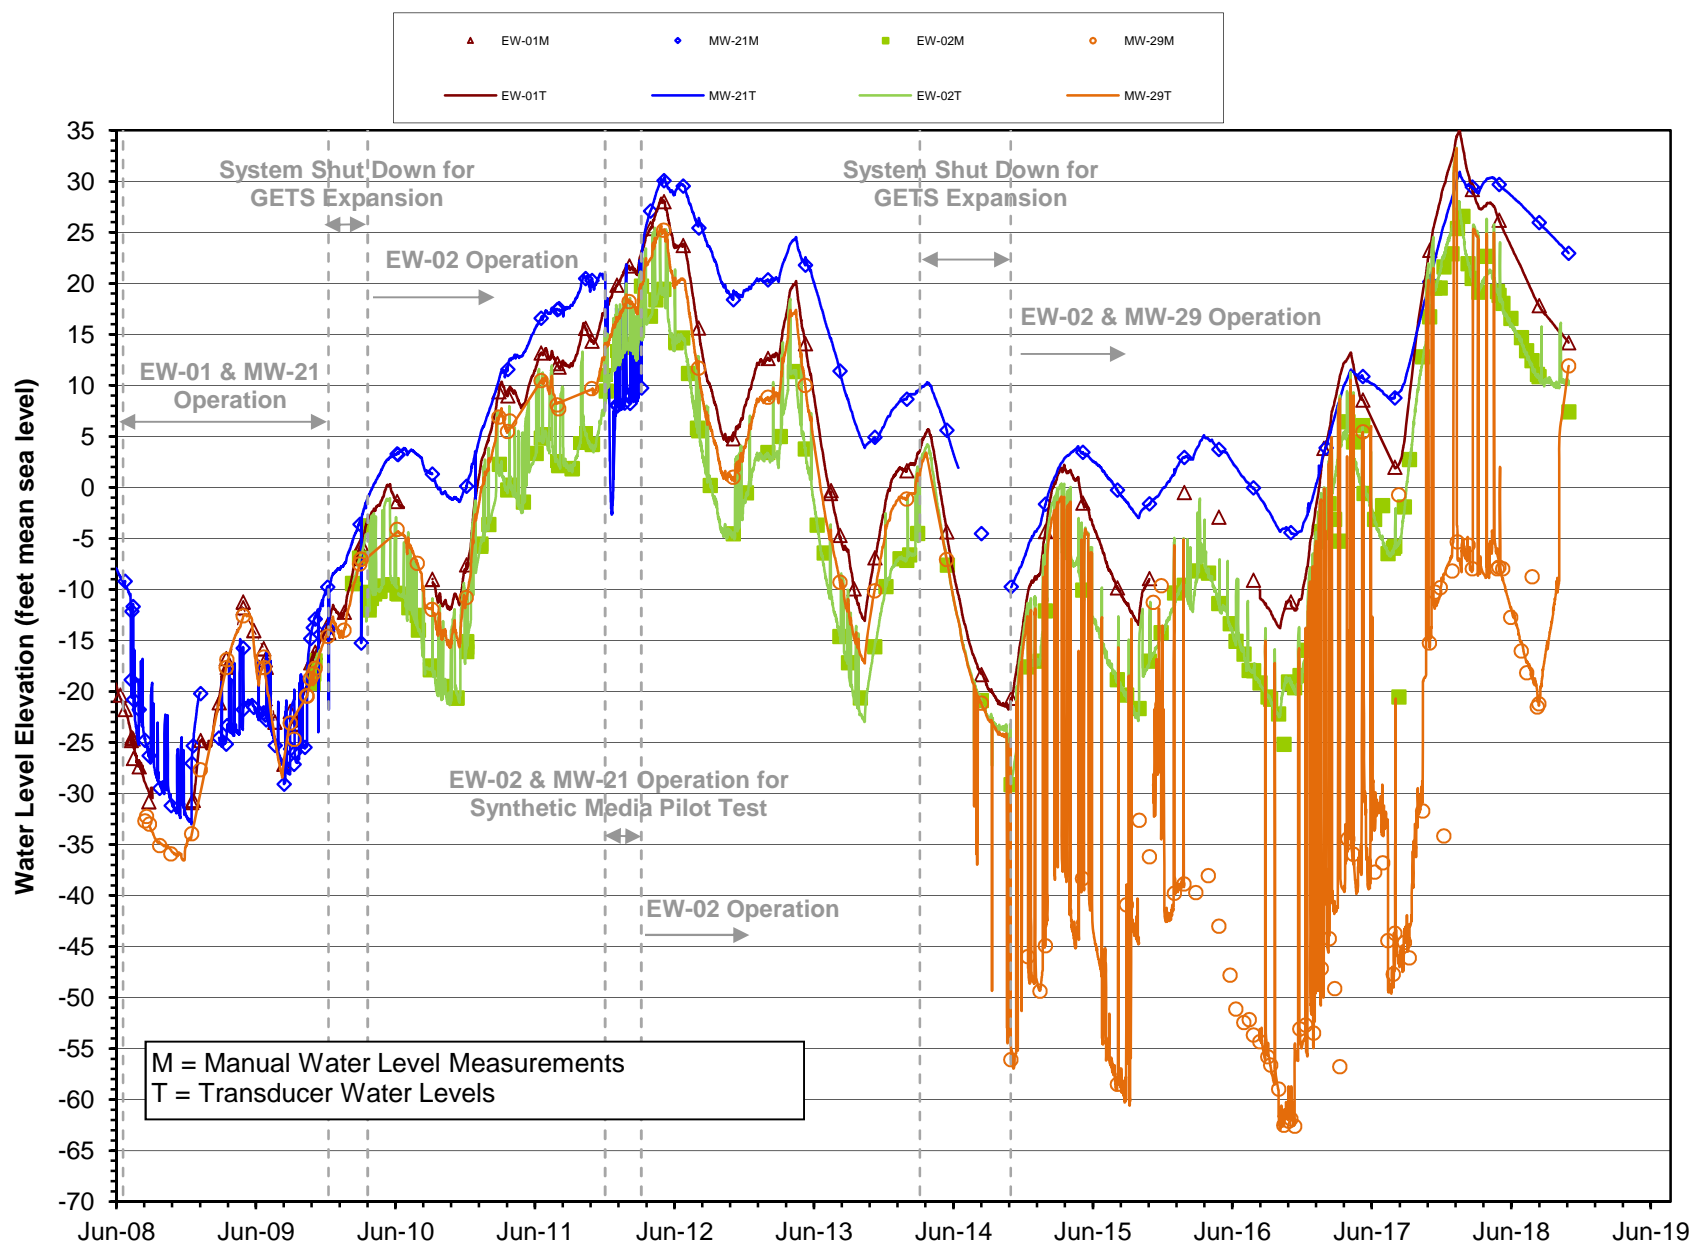


FIGURE 4.
PILOT GROUNDWATER EXTRACTION AND TREATMENT SYSTEM OPERATION
AND EXTRACTION WELL WATER LEVELS

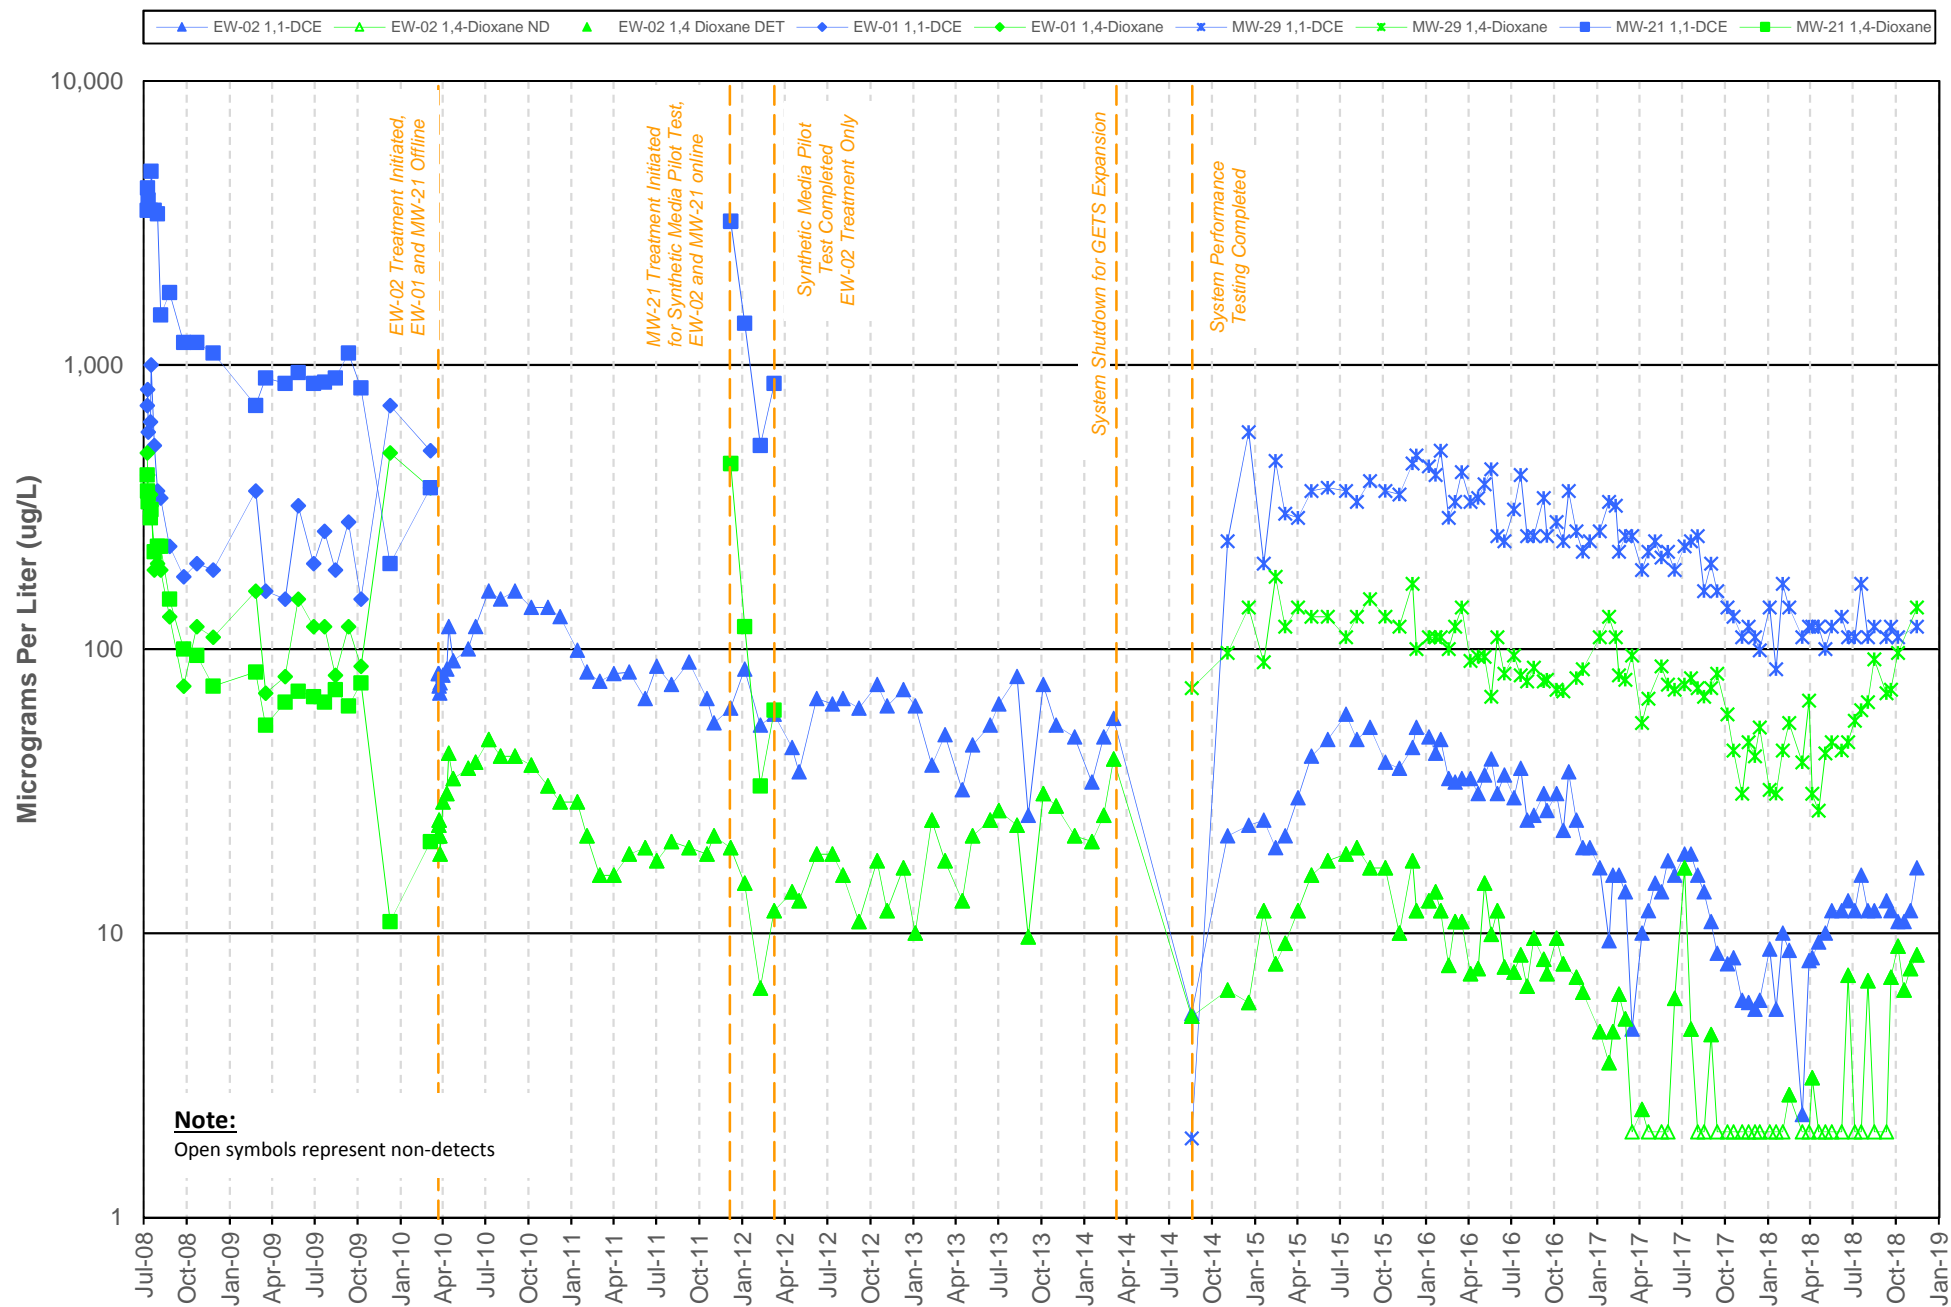


FIGURE 5.
1,1-DICHLOROETHYLENE AND 1,4-DIOXANE CONCENTRATIONS IN EXTRACTION WELLS

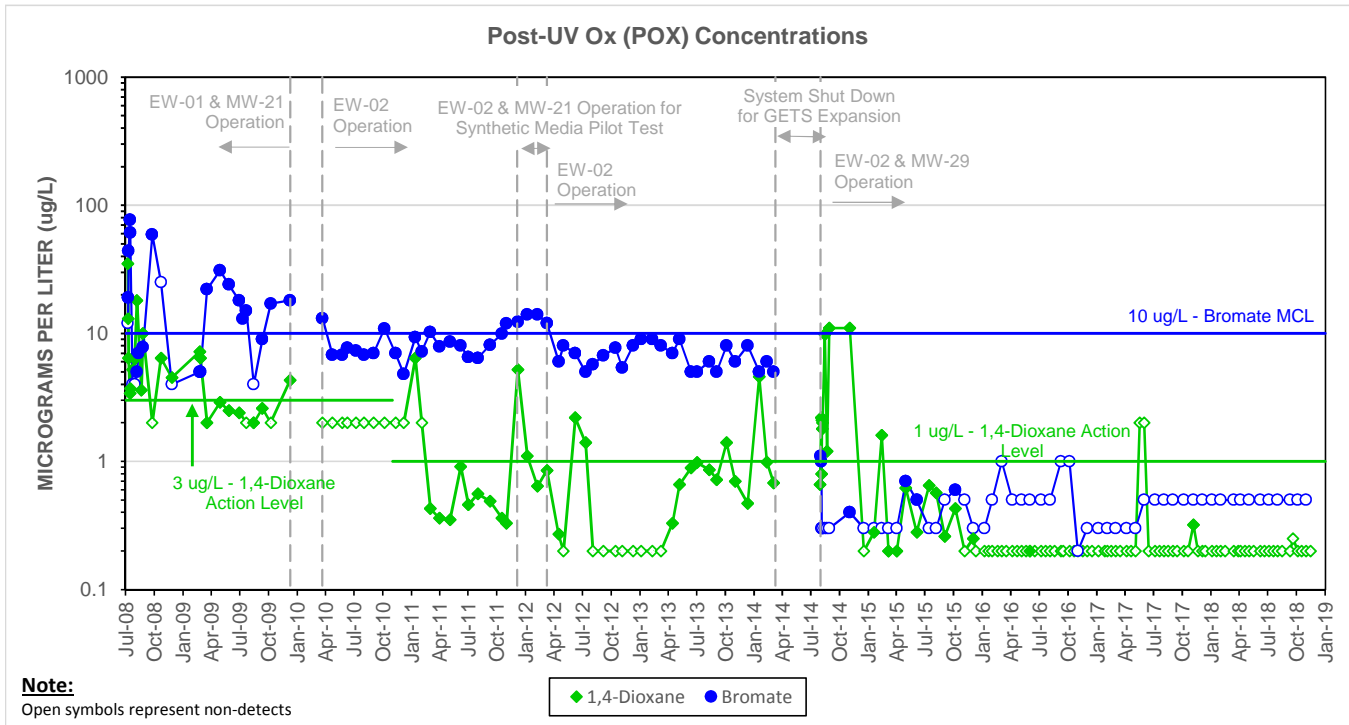
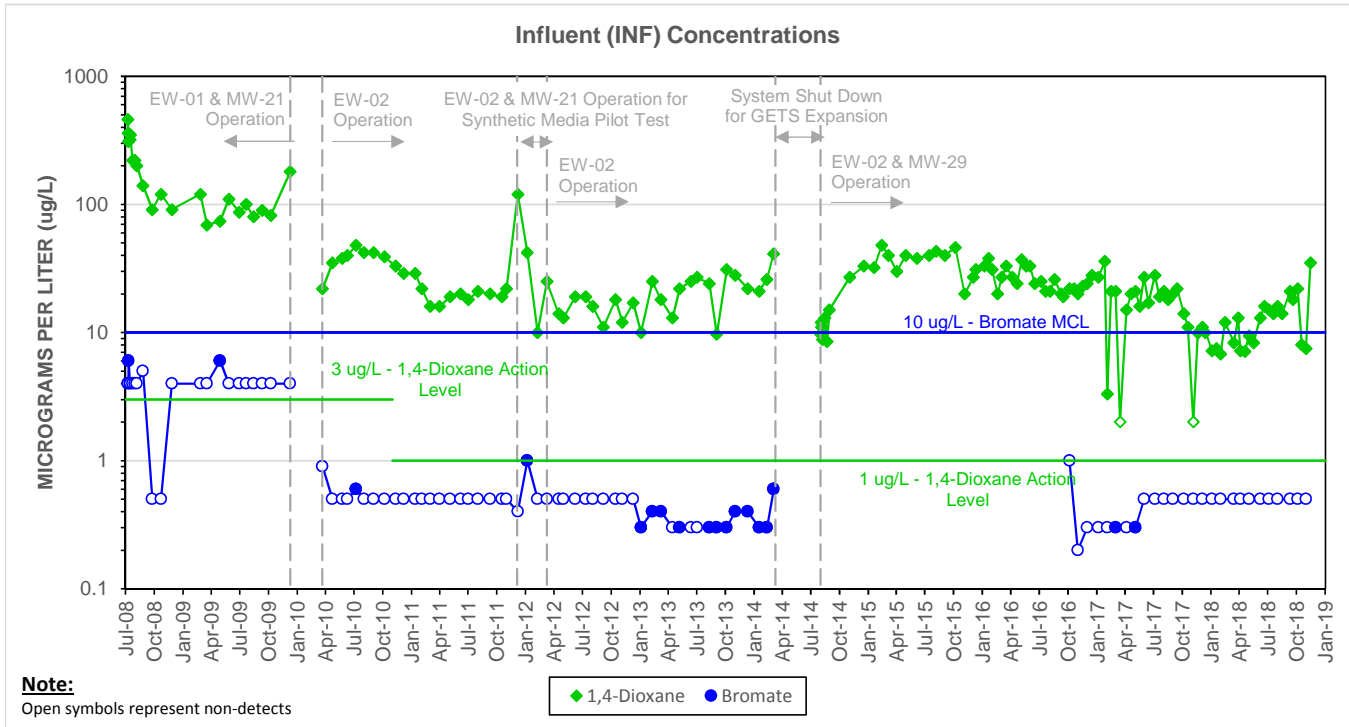


FIGURE 6.
1,4-DIOXANE AND BROMATE IN INFLUENT AND POST-OXIDATION SAMPLES